

2020 BND WATER LINES REPLACEMENTS



VICINITY MAP - NOT TO SCALE


INDEX

INDEX..... SHEET 1 OF 14



PROPOSED WATER LINE IMPROVEMENTS..... SHEET 2-13 OF 14

WATER CONSTRUCTION DETAILS SHEET 14 OF 14

DATE	REVISION
6/22/2020	ISSUED FOR BIDS
6/29/2020	REVISED
7/2/2020	ADDENDUM #1
7/10/2020	ADDENDUM #2
7/16/2020	ADDENDUM #3

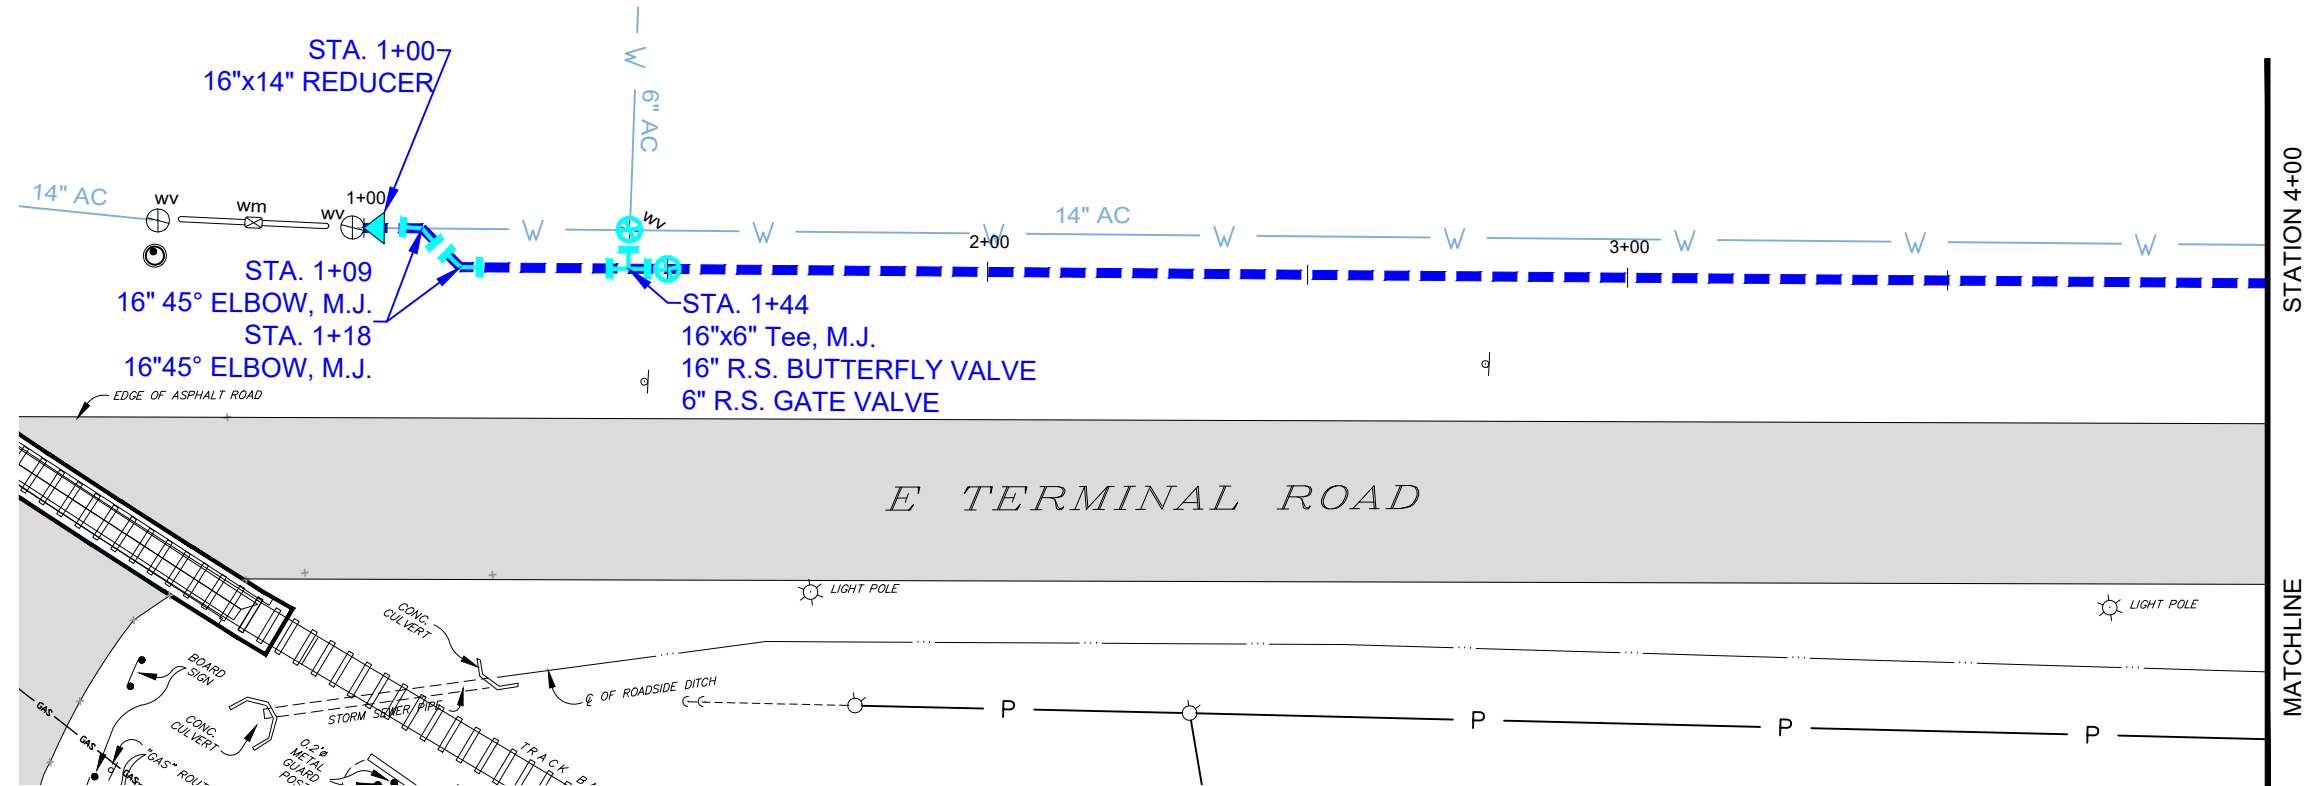


- NOTES:
1. BEFORE CONSTRUCTION CALL DIGTESS (1-800-344-8311), A NON-PROFIT UTILITY SPOTTING ORGANIZATION.
 2. VERIFY EXISTING WATER LINES PRIOR TO ORDERING FITTINGS.
 3. ALL FITTING SHALL BE MECHANICAL JOINT UNLESS SPECIFIED IN WRITING BY THE ENGINEER.
 4. LOCATION OF NEW FIRE HYDRANT WITH VALVE & BOX (6) TO BE DETERMINED ON FIELD.

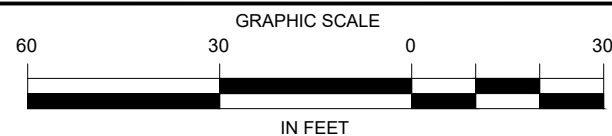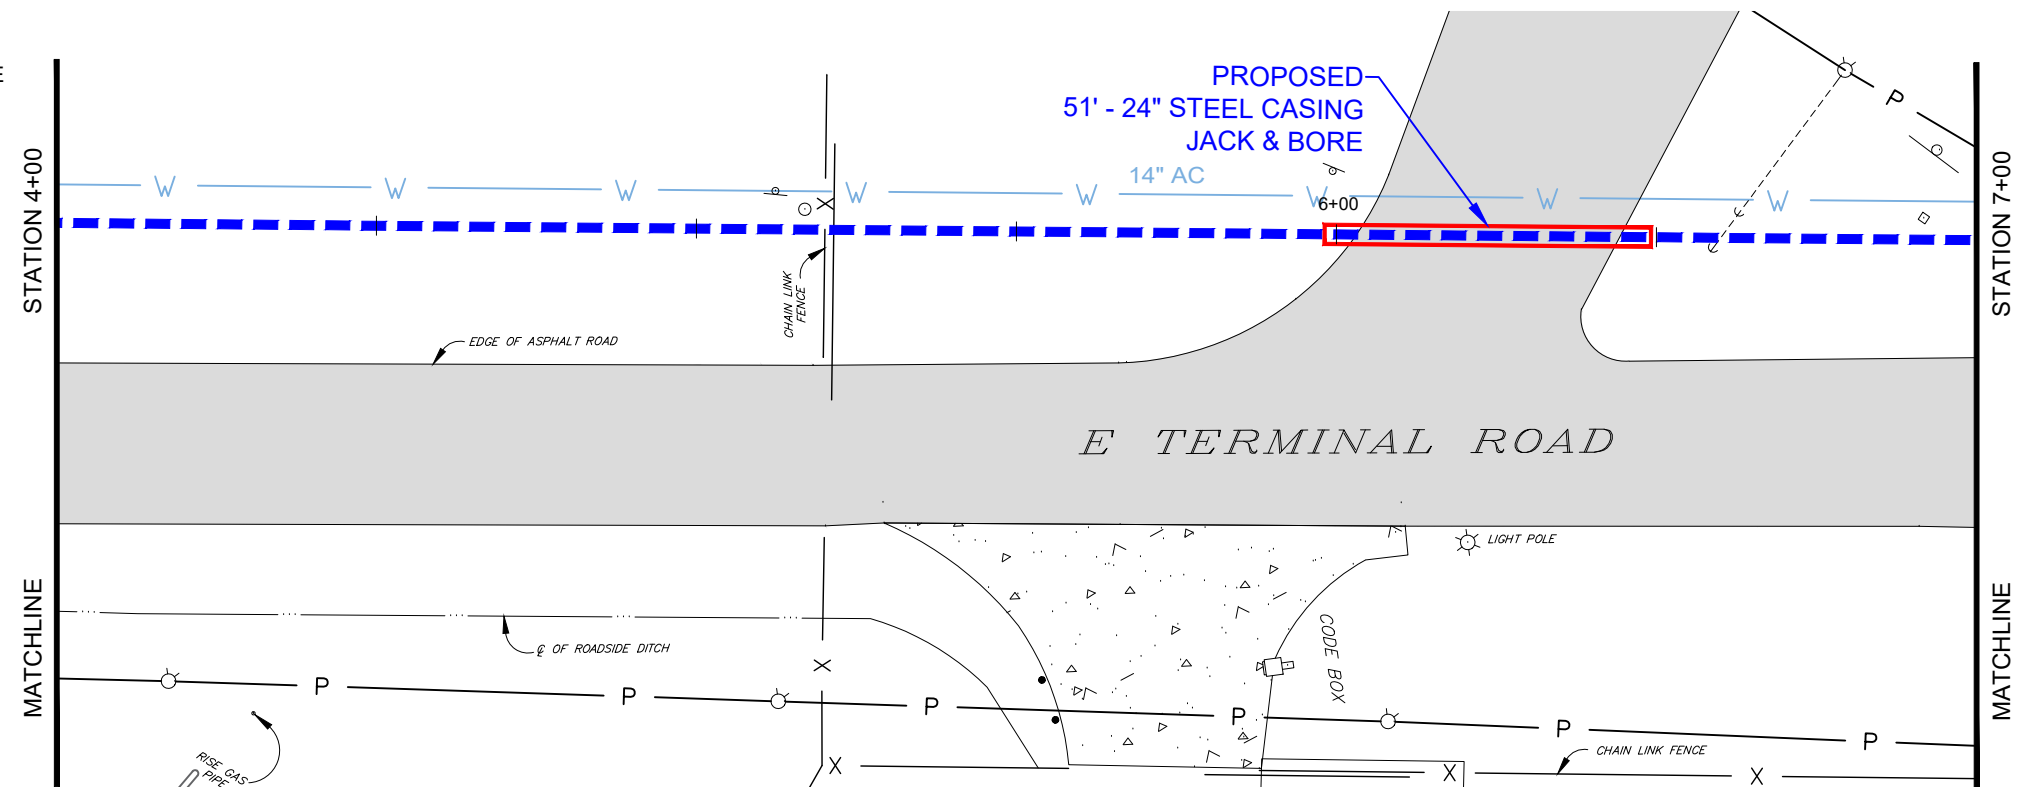


BROWNSVILLE NAVIGATION DISTRICT
ENGINEERING DEPARTMENT
BROWNSVILLE, TEXAS 78521
PHONE (956) 831-4592 1-800-378-5395
FAX (956) 831-6153
EMAIL achavez@portofbrownsville.com

DRAWN BY:	P.E.	APPROVED BY:	
DATE DRAWN:	June 2020	REVISION DATE:	
CHECKED BY:	A. CHAVEZ II	DWG. NO.	
SCALE:	AS SHOWN	FILE NAME:	C:\MY DRAWINGS\2020\water\2020WATERLINESREPLACEMENT\16in-06SH46.dwg

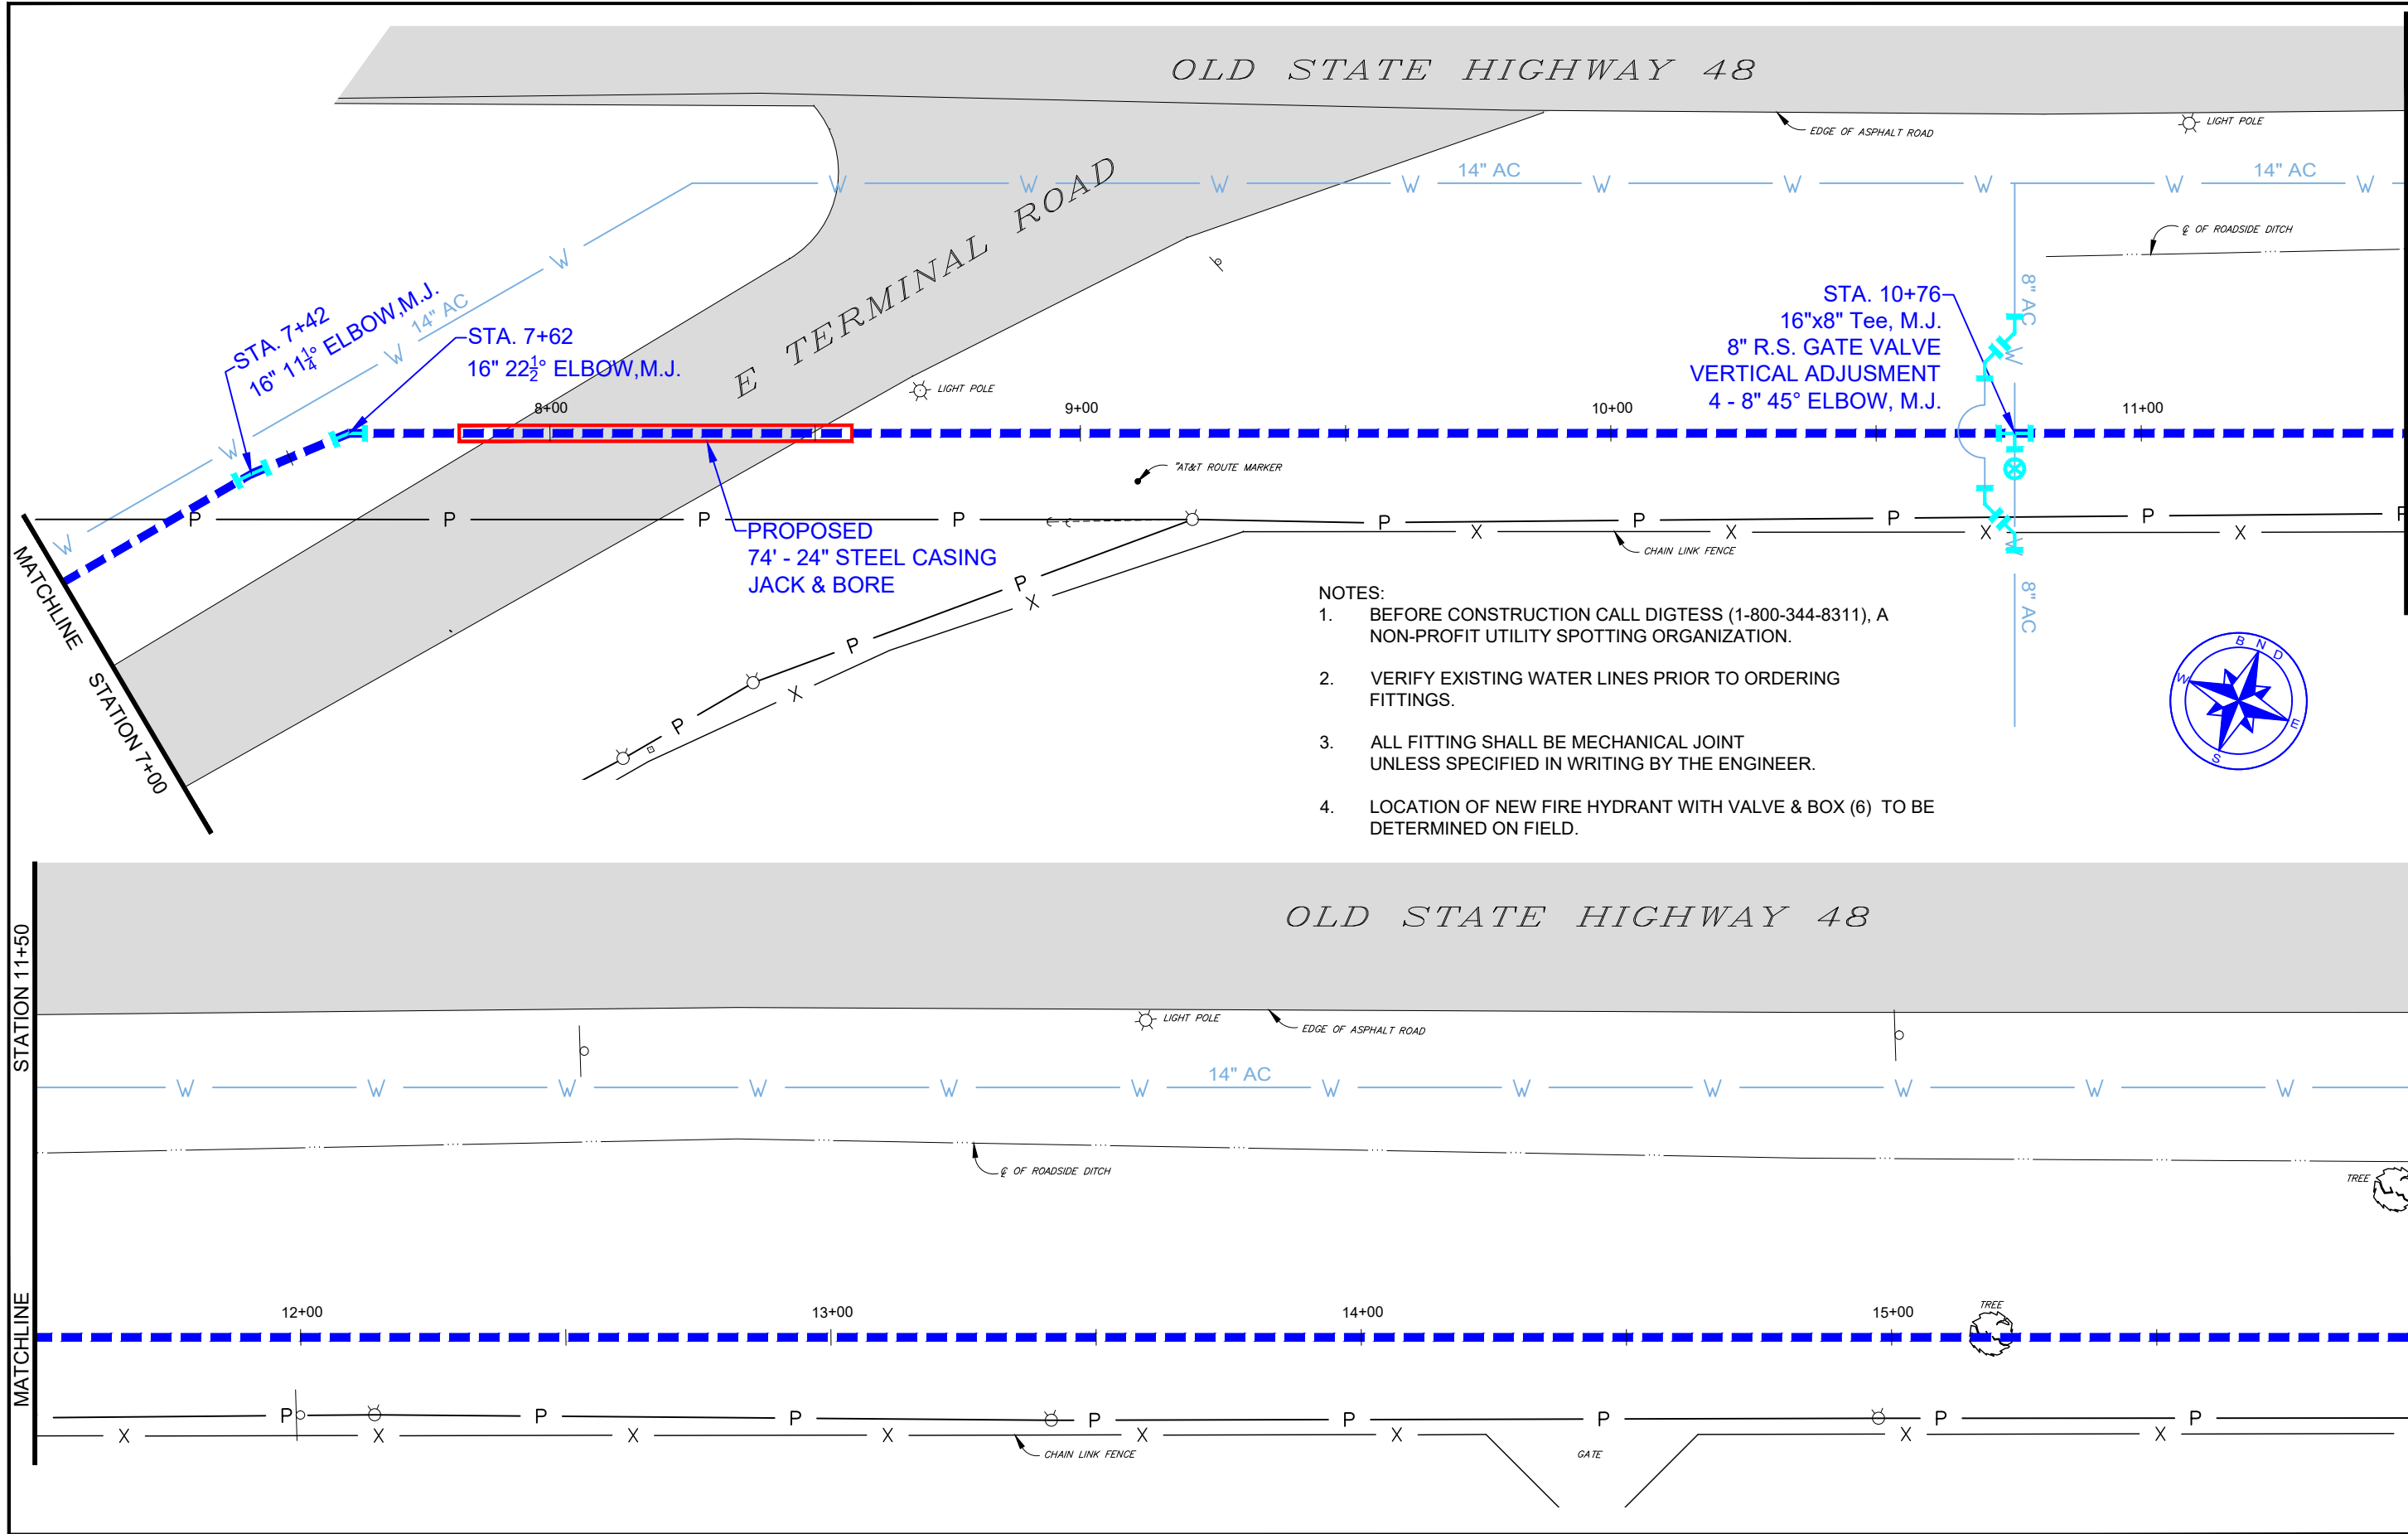

- NOTES:
- 1. BEFORE CONSTRUCTION CALL DIGTESS (1-800-344-8311), A NON-PROFIT UTILITY SPOTTING ORGANIZATION.
 - 2. VERIFY EXISTING WATER LINES PRIOR TO ORDERING FITTINGS.
 - 3. ALL FITTING SHALL BE MECHANICAL JOINT UNLESS SPECIFIED IN WRITING BY THE ENGINEER.
 - 4. LOCATION OF NEW FIRE HYDRANT WITH VALVE & BOX (6) TO BE DETERMINED ON FIELD.

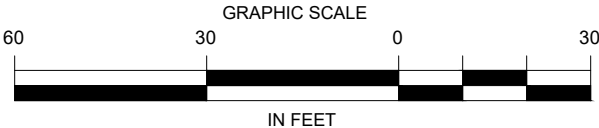

BROWNSVILLE NAVIGATION DISTRICT
ENGINEERING DEPARTMENT
BROWNSVILLE, TEXAS 78521
PHONE (956) 831-4592 1-800-378-5395
FAX (956) 831-6153
EMAIL achavez@portofbrownsville.com

PORT OF BROWNSVILLE
the port that works

PROPOSED
16" WATERLINE
STA. 7+00 - 16+00


2020 BND WATER
LINES REPLACEMENT

DRAWN BY: P.E.	APPROVED BY:
DATE DRAWN: June 2020	REVISION DATE:
CHECKED BY: A. CHAVEZ II	DWG. NO.
SCALE: AS SHOWN	FILE NAME: C:\MY DRAWINGS\2020\water\2020WATERLINESREPLACEMENT\16in-OldSH48.dwg

SHEET

3

OF 14

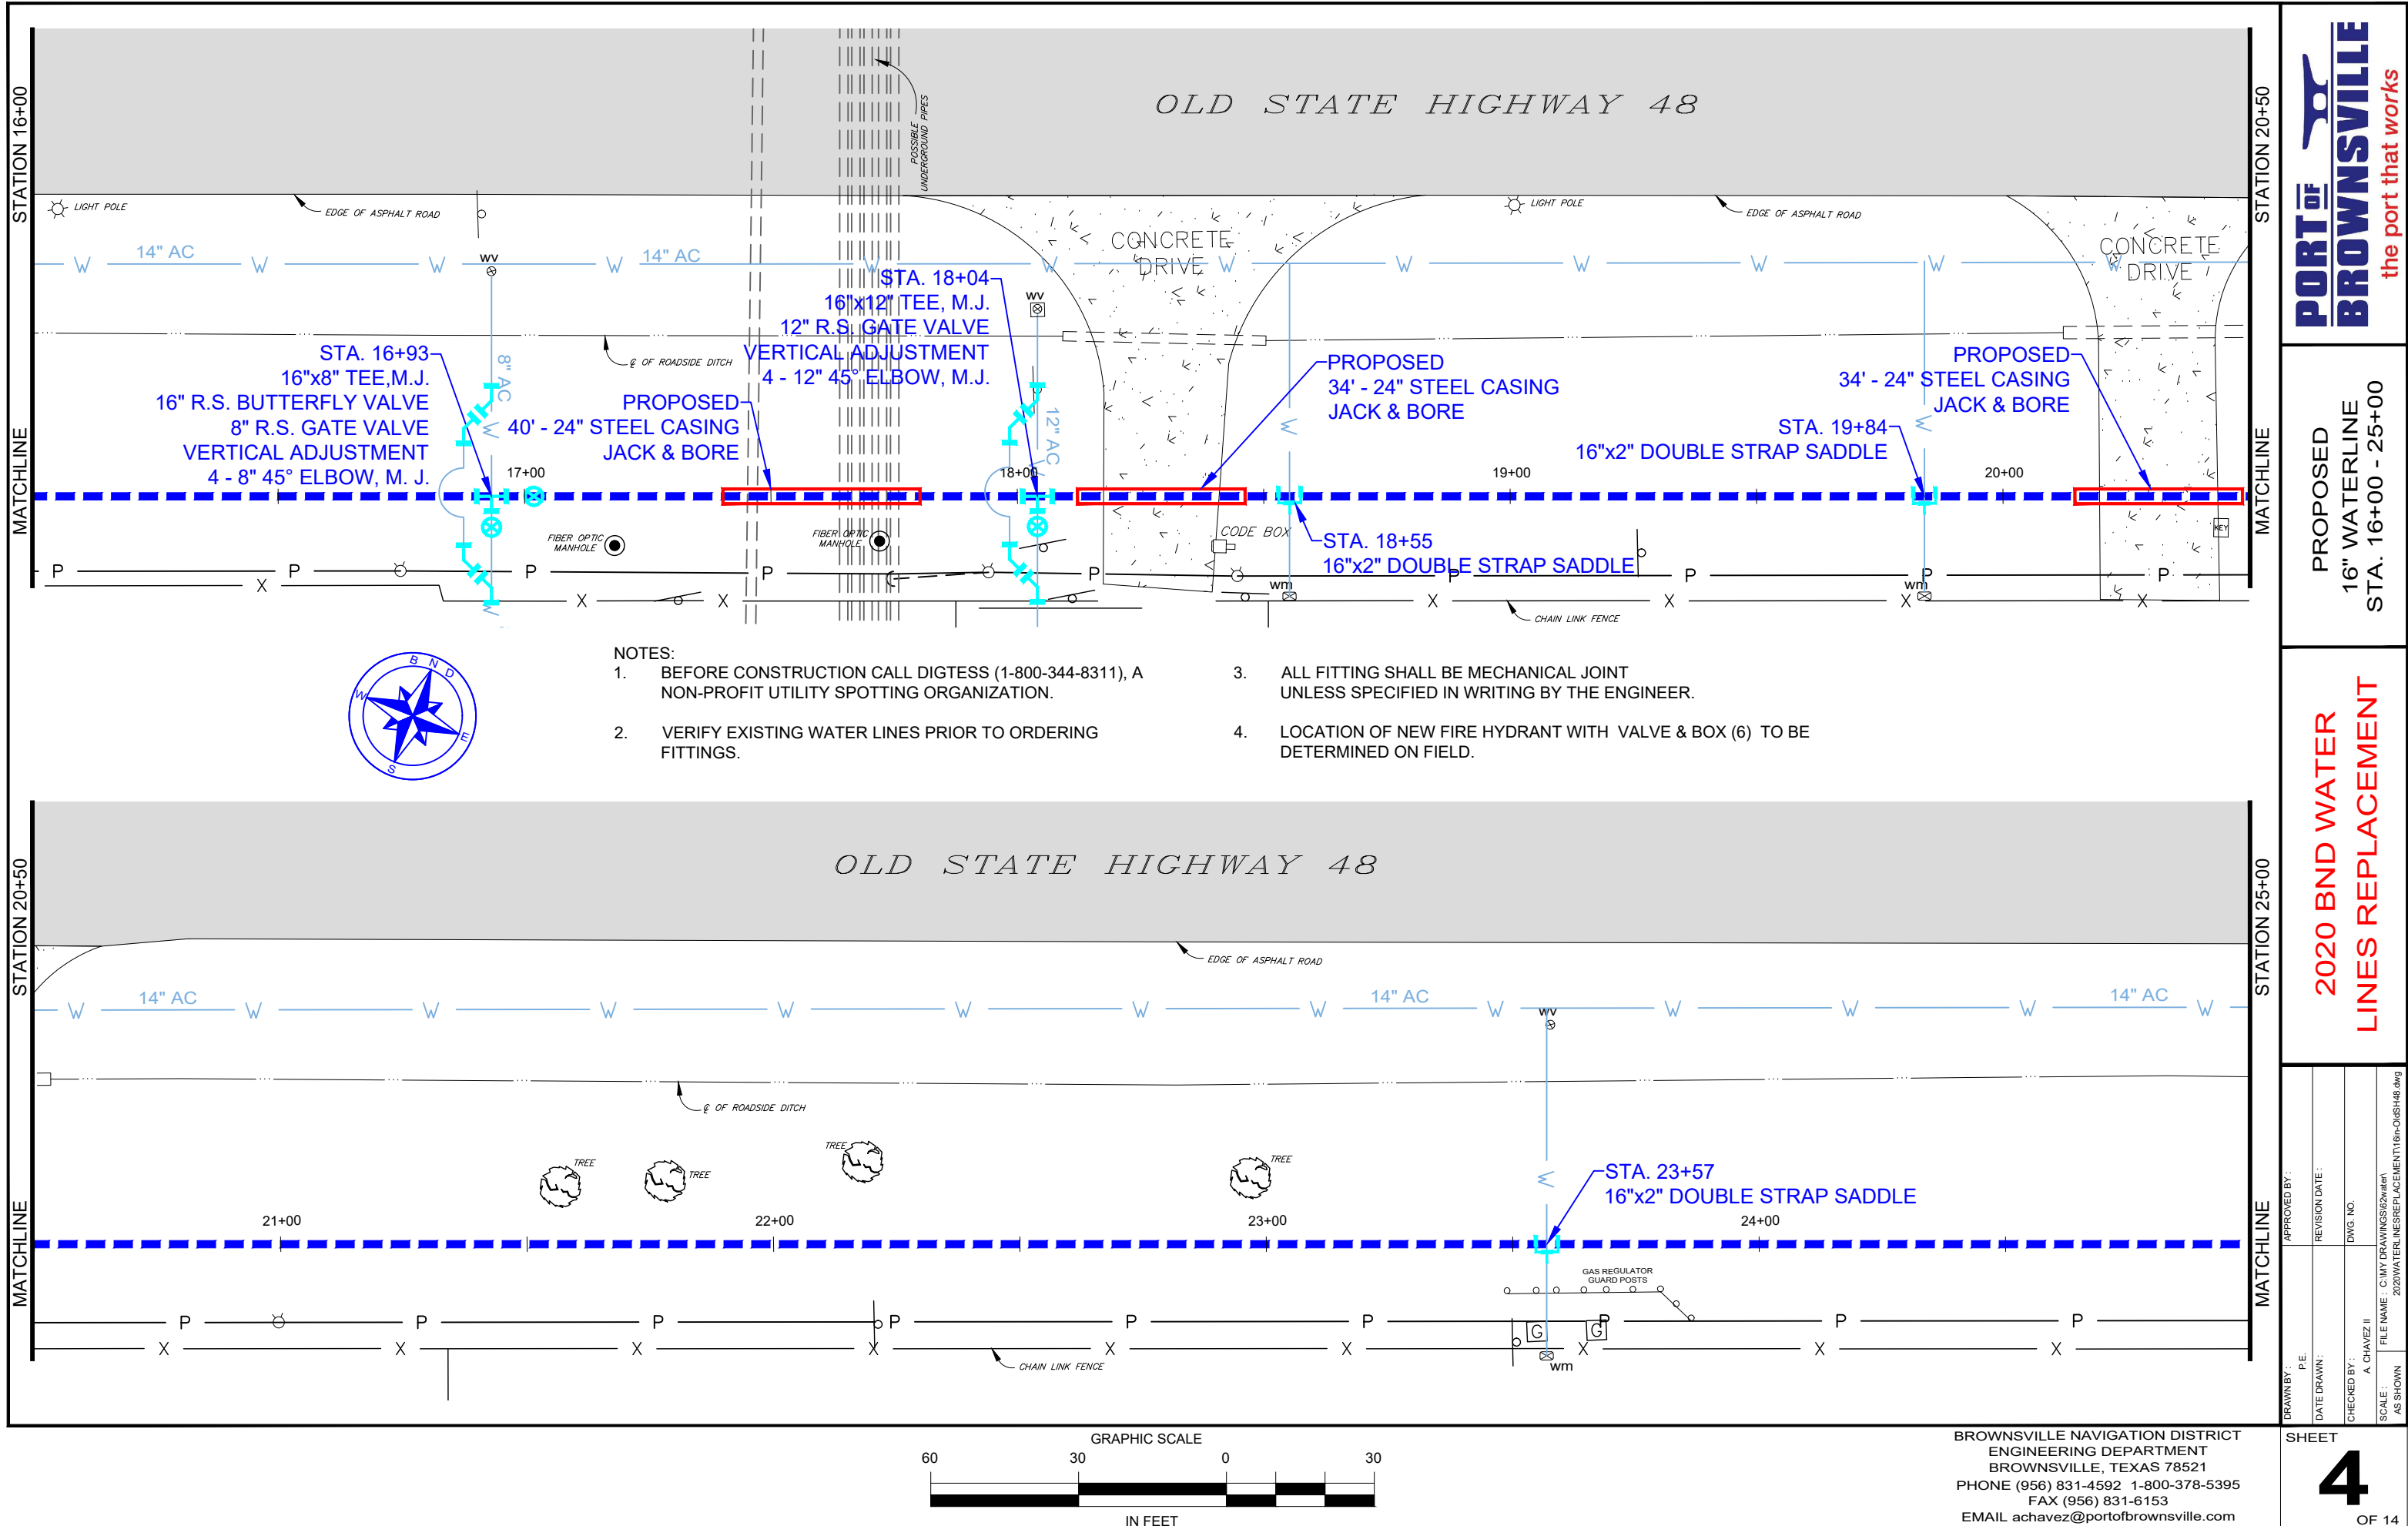


PROPOSED
16" WATERLINE
STA. 16+00 - 25+00



2020 BND WATER
LINES REPLACEMENT

DRAWN BY:	APPROVED BY:
DATE DRAWN:	REVISION DATE:
CHECKED BY:	DWG. NO.
SCALE:	FILE NAME: C:\MY DRAWINGS\2020\water\2020WATERLINESREPLACEMENT\16in-OldSH48.dwg
AS SHOWN	A. CHAVEZ II

BROWNSVILLE NAVIGATION DISTRICT
ENGINEERING DEPARTMENT
BROWNSVILLE, TEXAS 78521
PHONE (956) 831-4592 1-800-378-5395
FAX (956) 831-6153
EMAIL achavez@portofbrownsville.com

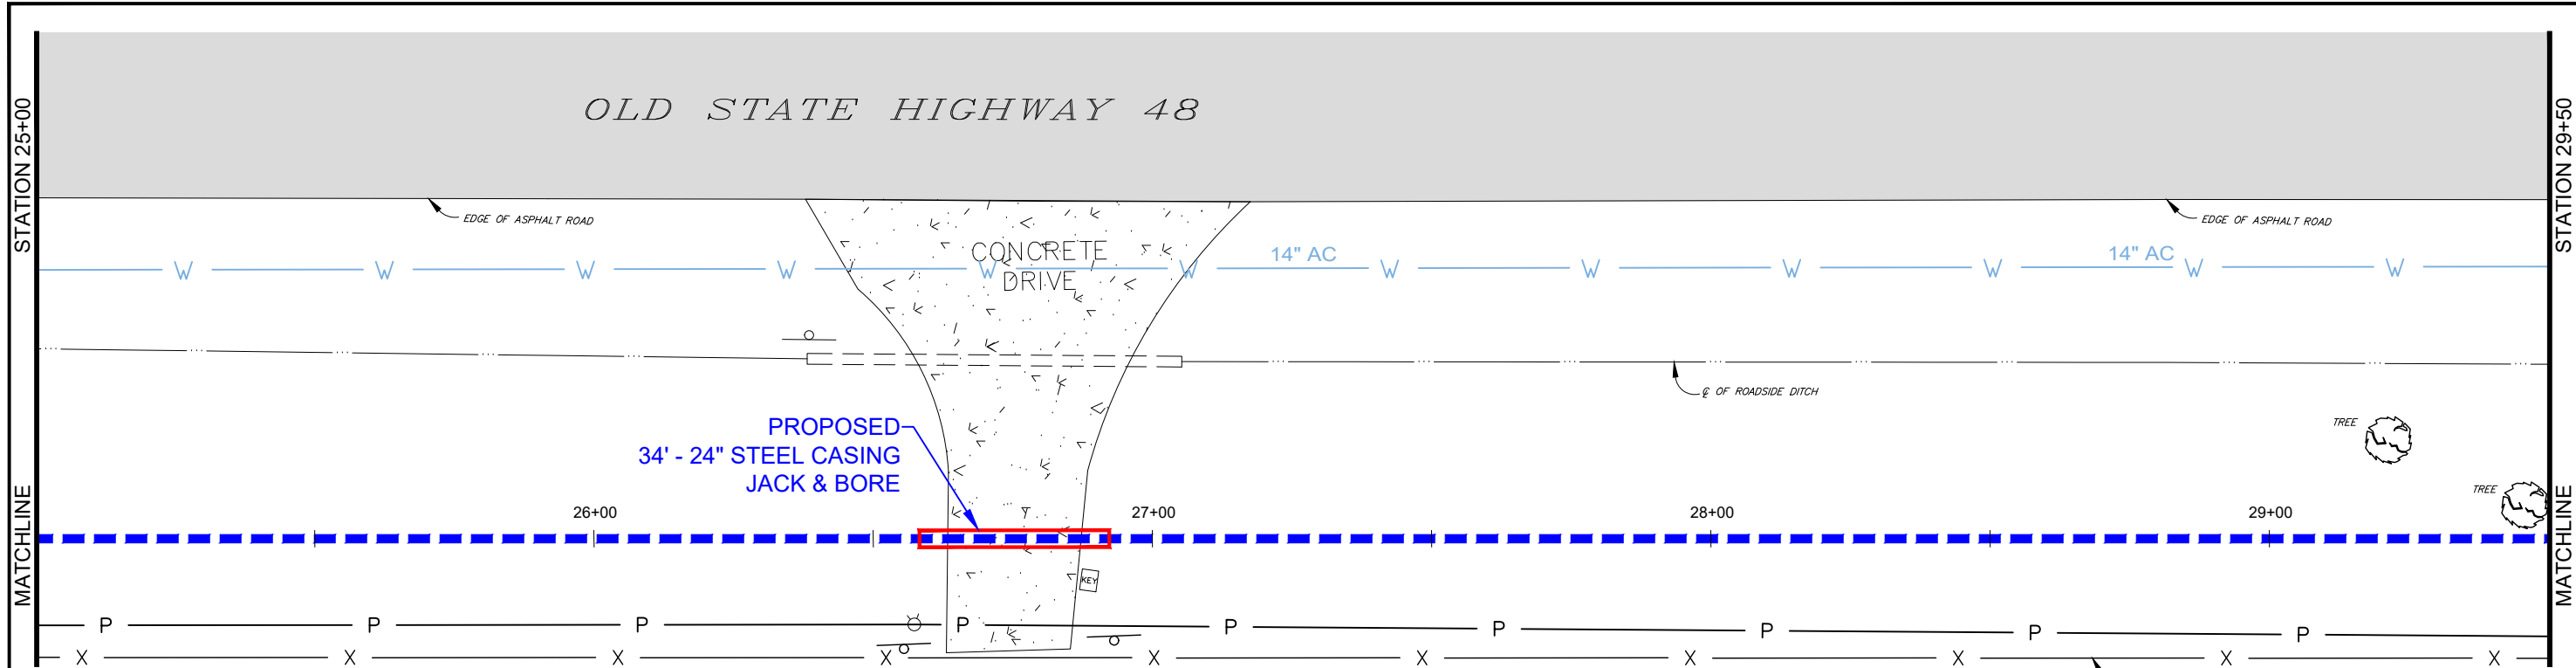

- NOTES:
1. BEFORE CONSTRUCTION CALL DIGTESS (1-800-344-8311), A NON-PROFIT UTILITY SPOTTING ORGANIZATION.
 2. VERIFY EXISTING WATER LINES PRIOR TO ORDERING FITTINGS.
 3. ALL FITTING SHALL BE MECHANICAL JOINT UNLESS SPECIFIED IN WRITING BY THE ENGINEER.
 4. LOCATION OF NEW FIRE HYDRANT WITH VALVE & BOX (6) TO BE DETERMINED ON FIELD.

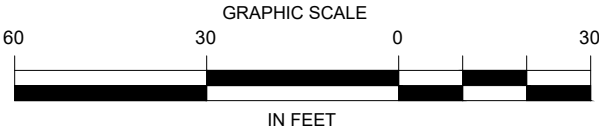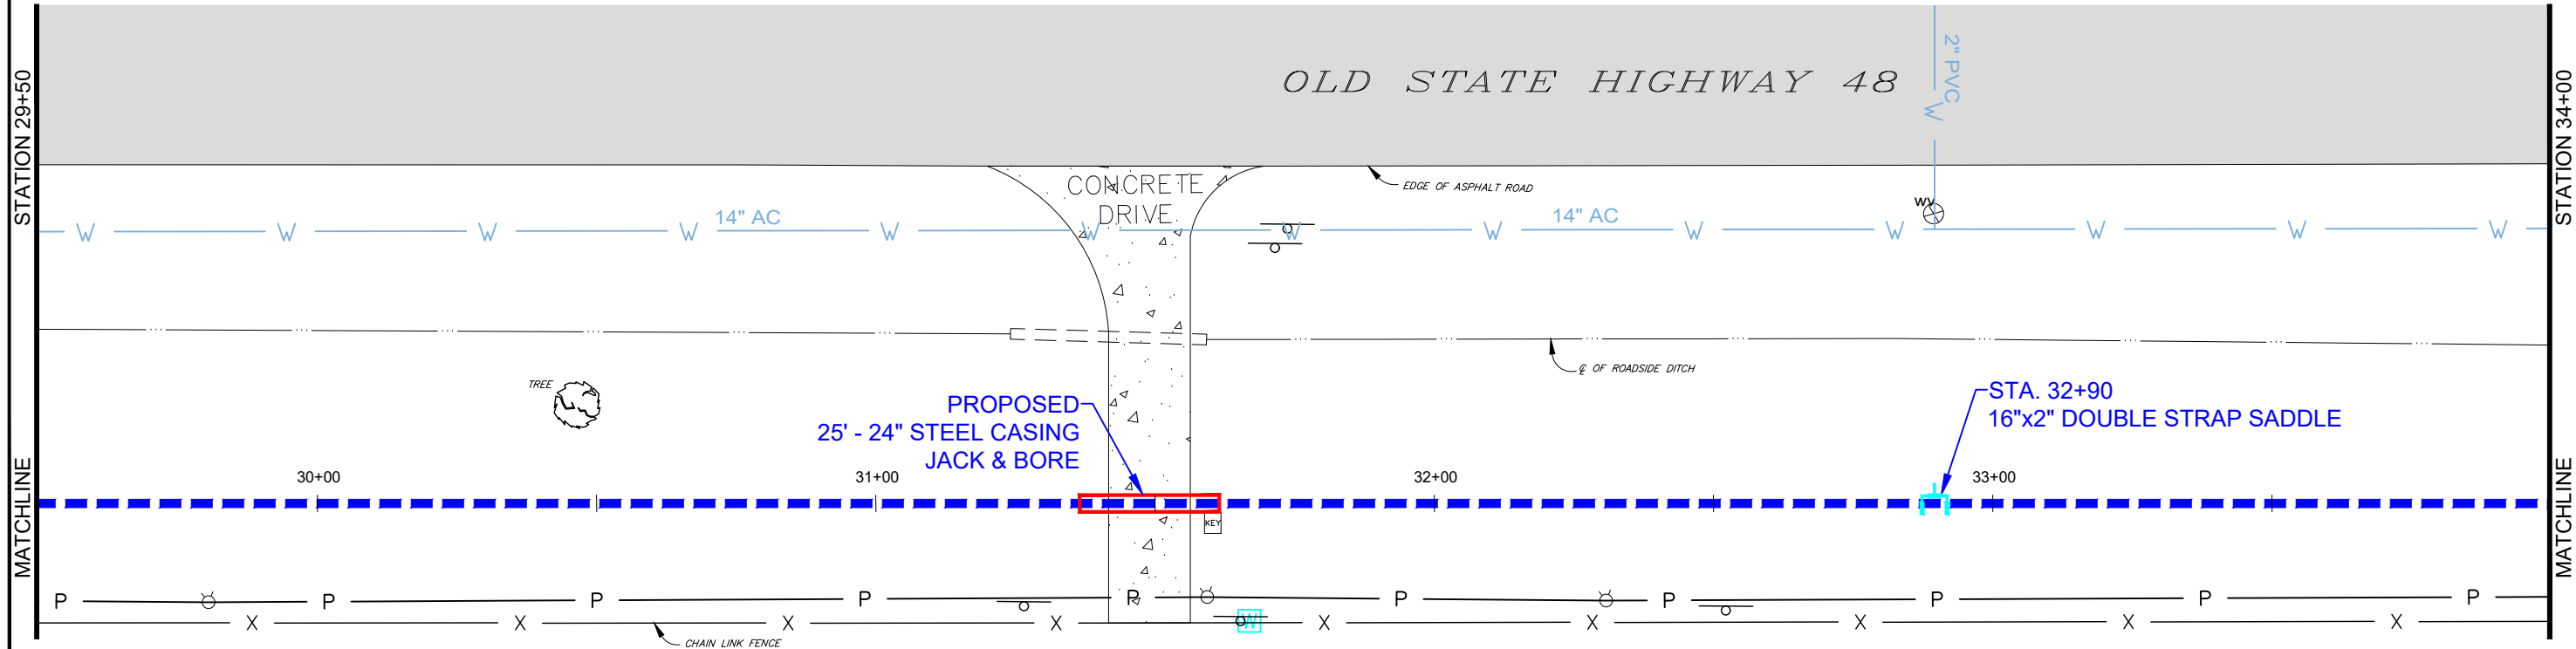

BROWNSVILLE NAVIGATION DISTRICT
ENGINEERING DEPARTMENT
BROWNSVILLE, TEXAS 78521
PHONE (956) 831-4592 1-800-378-5395
FAX (956) 831-6153
EMAIL achavez@portofbrownsville.com



the port that works

PROPOSED
16" WATERLINE
STA. 25+00 - 34+00


2020 BND WATER
LINES REPLACEMENT



DRAWN BY:	APPROVED BY:
DATE DRAWN: June 2020	REVISION DATE:
CHECKED BY: A. CHAVEZ II	DWG. NO.
SCALE: AS SHOWN	FILE NAME: C:\MY DRAWINGS\2020\water\2020WATERLINESREPLACEMENT\16in-OldSH48.dwg

SHEET


5

OF 14

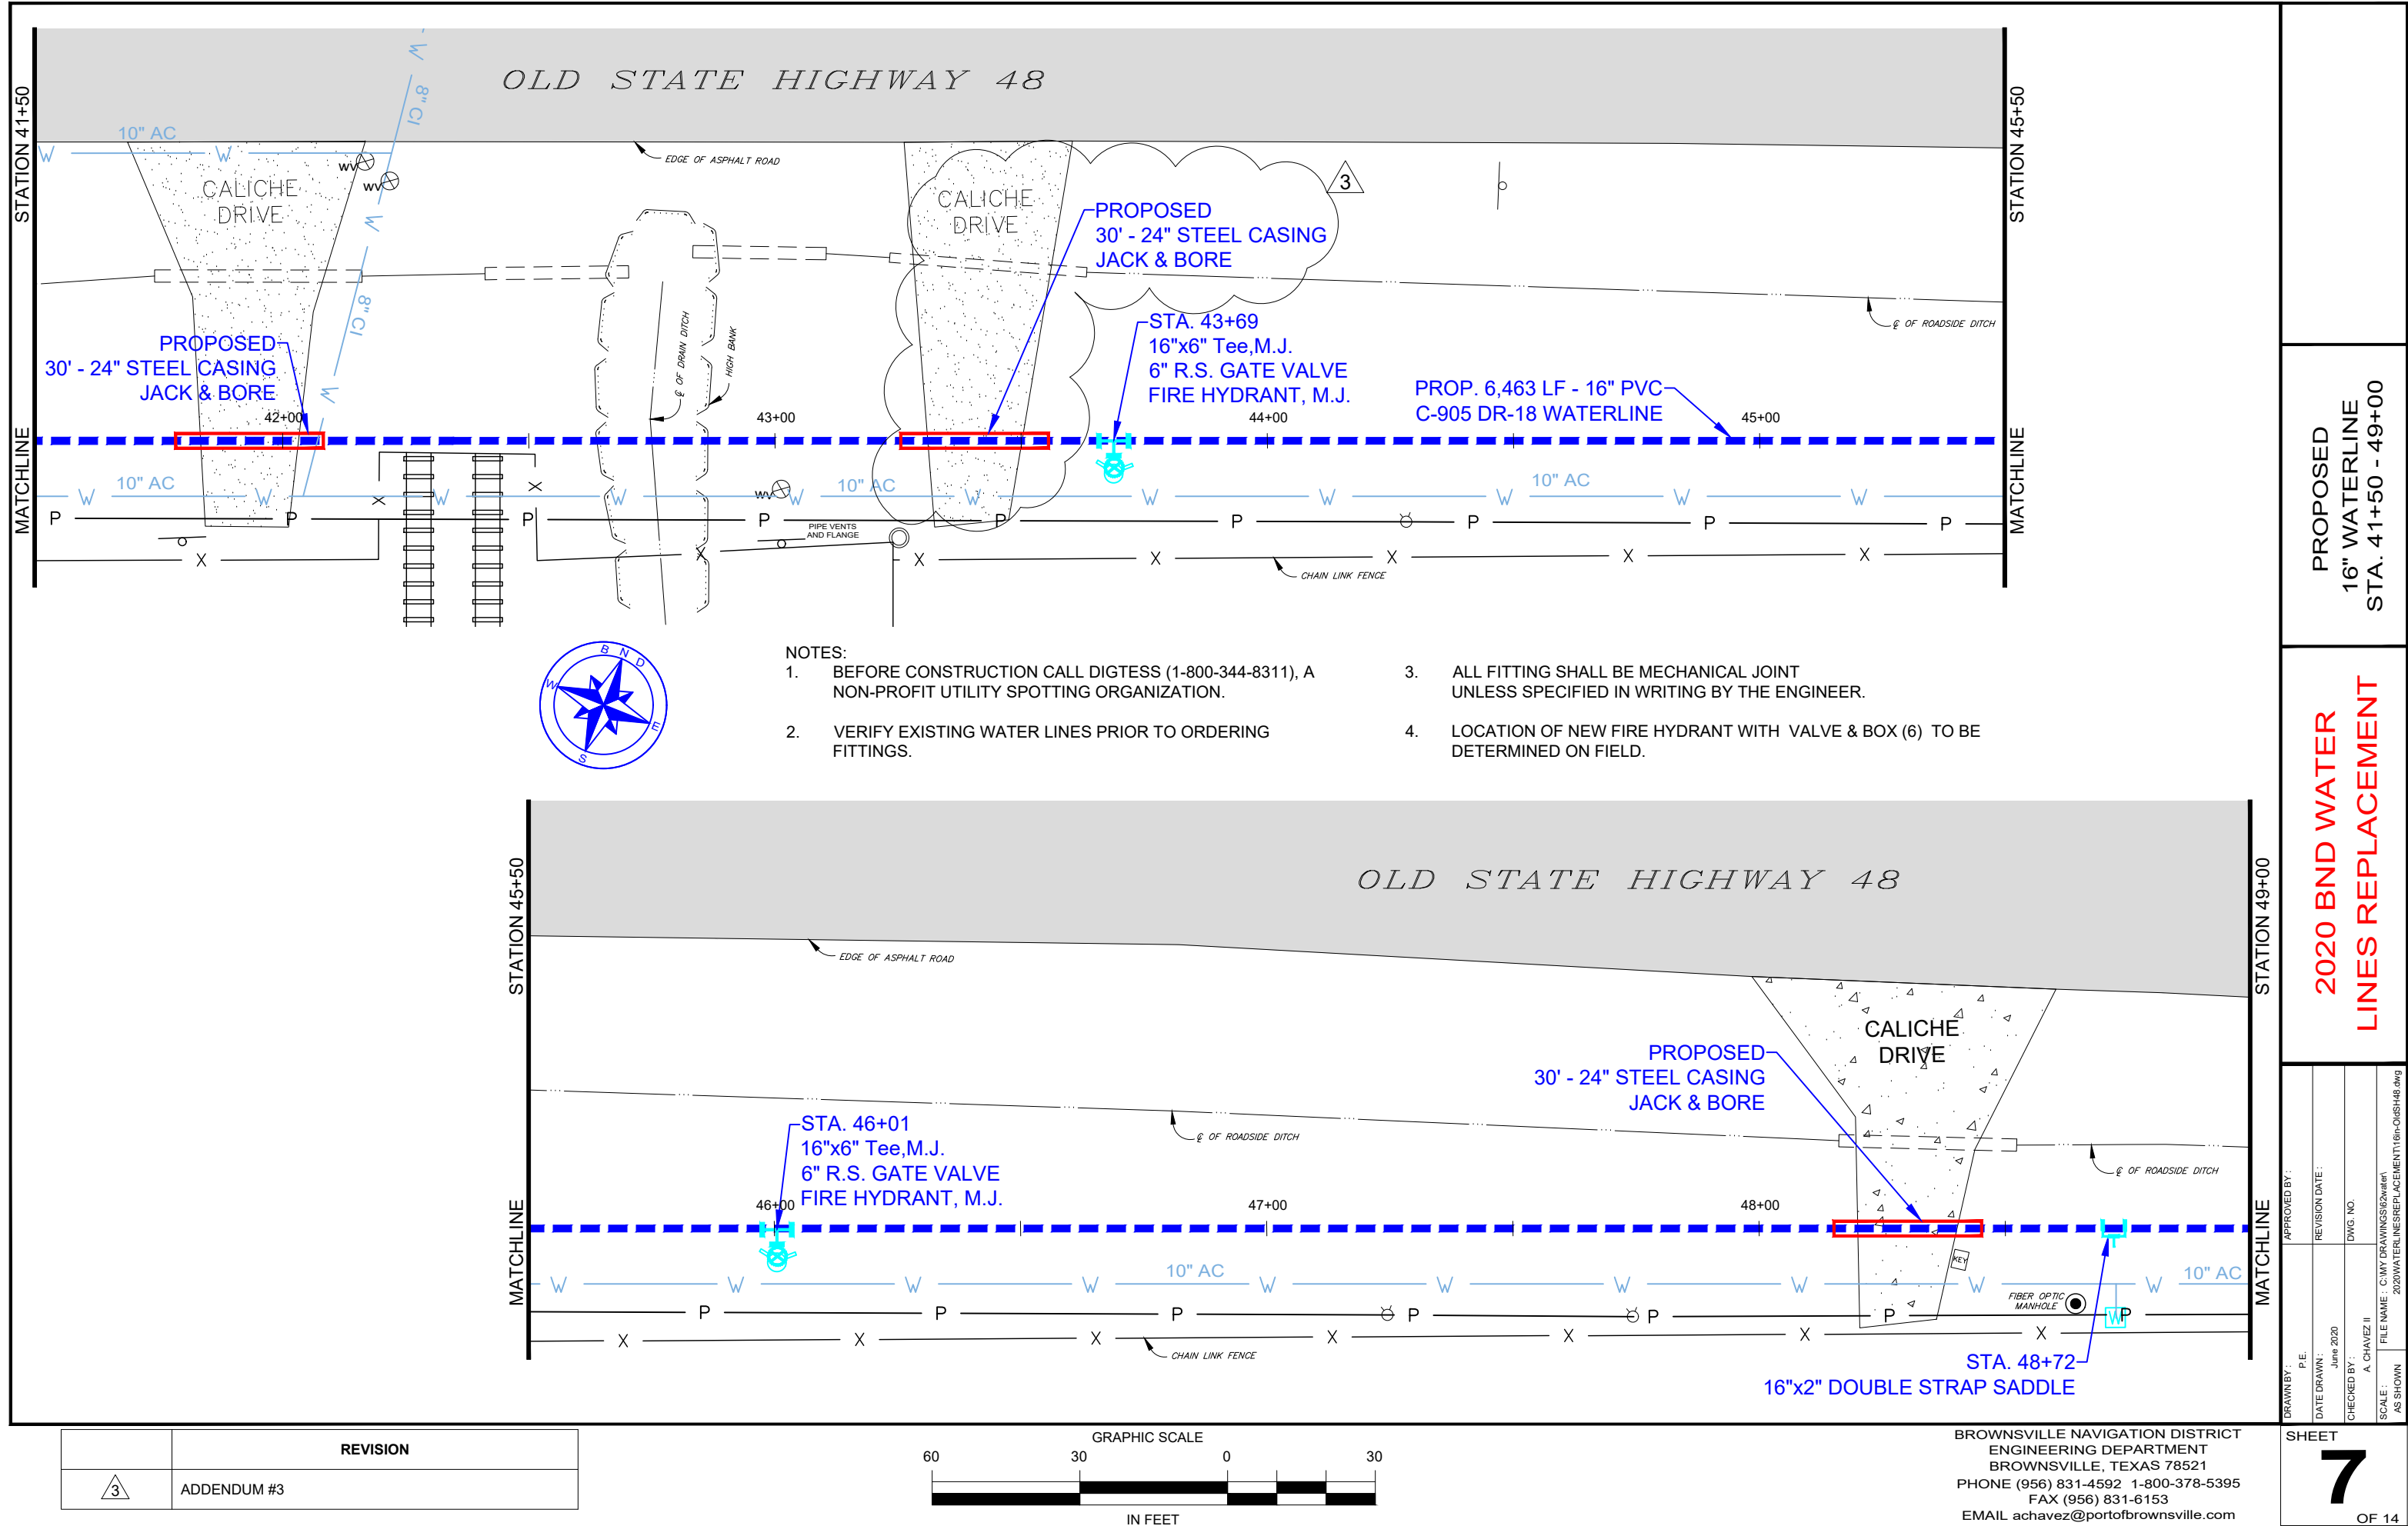

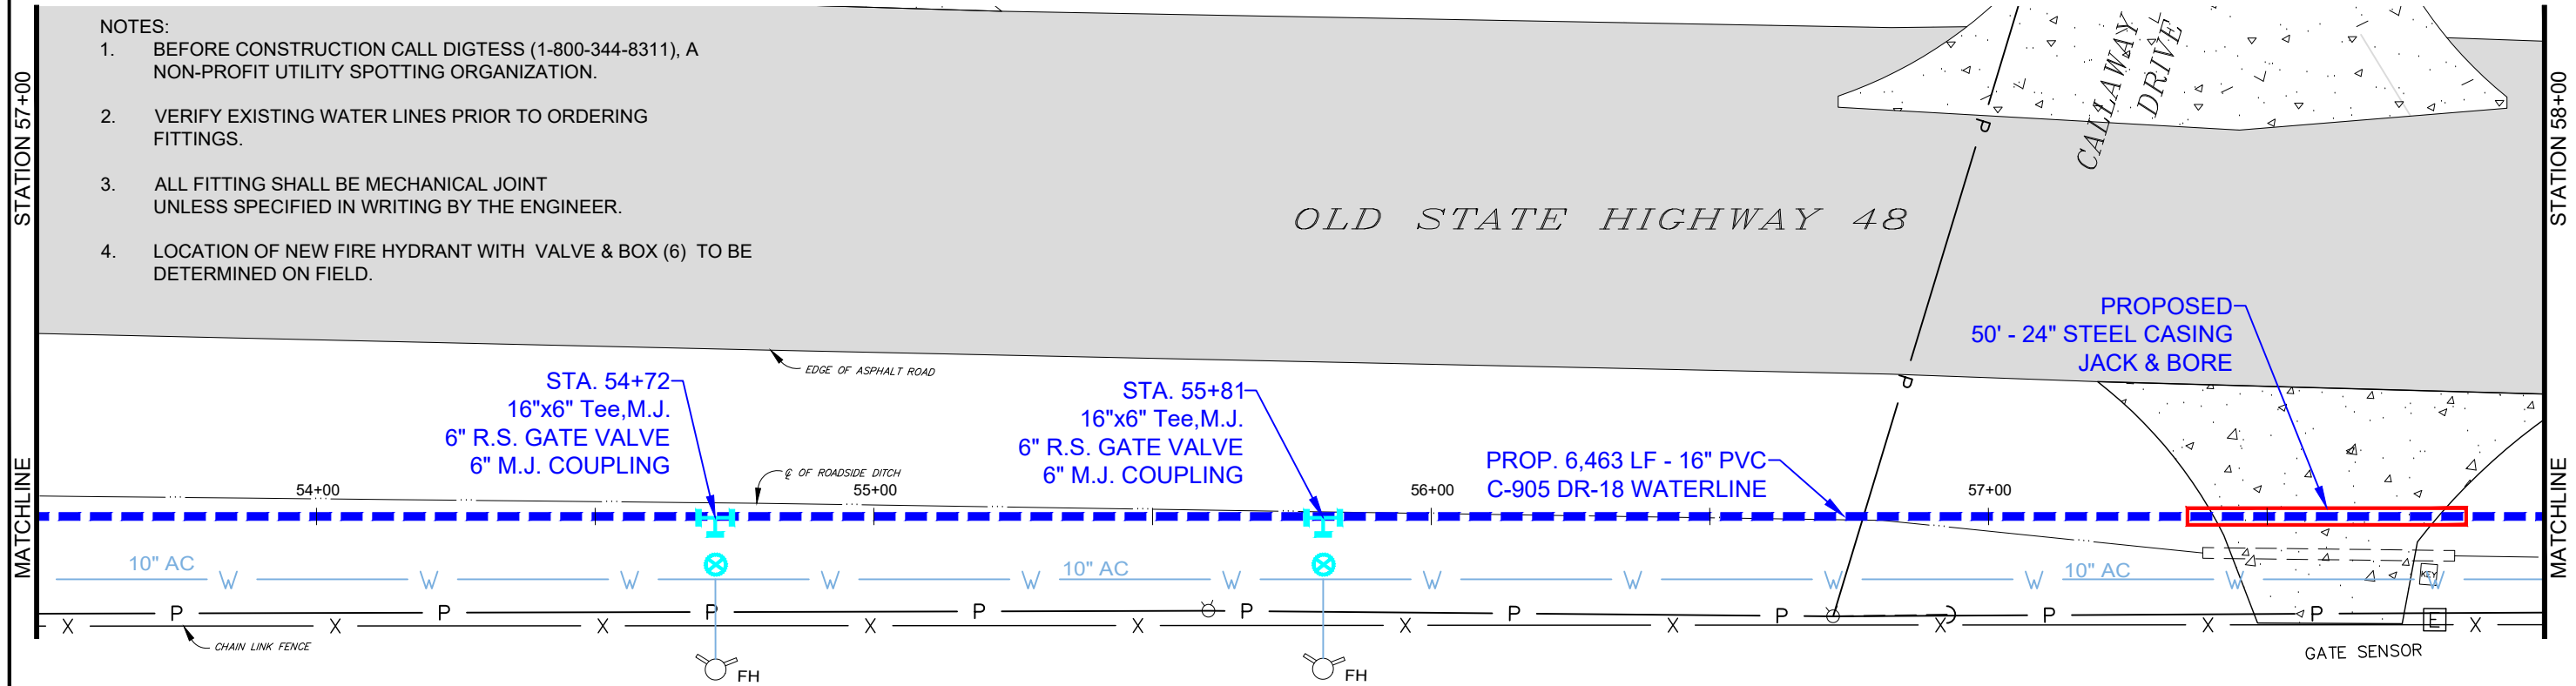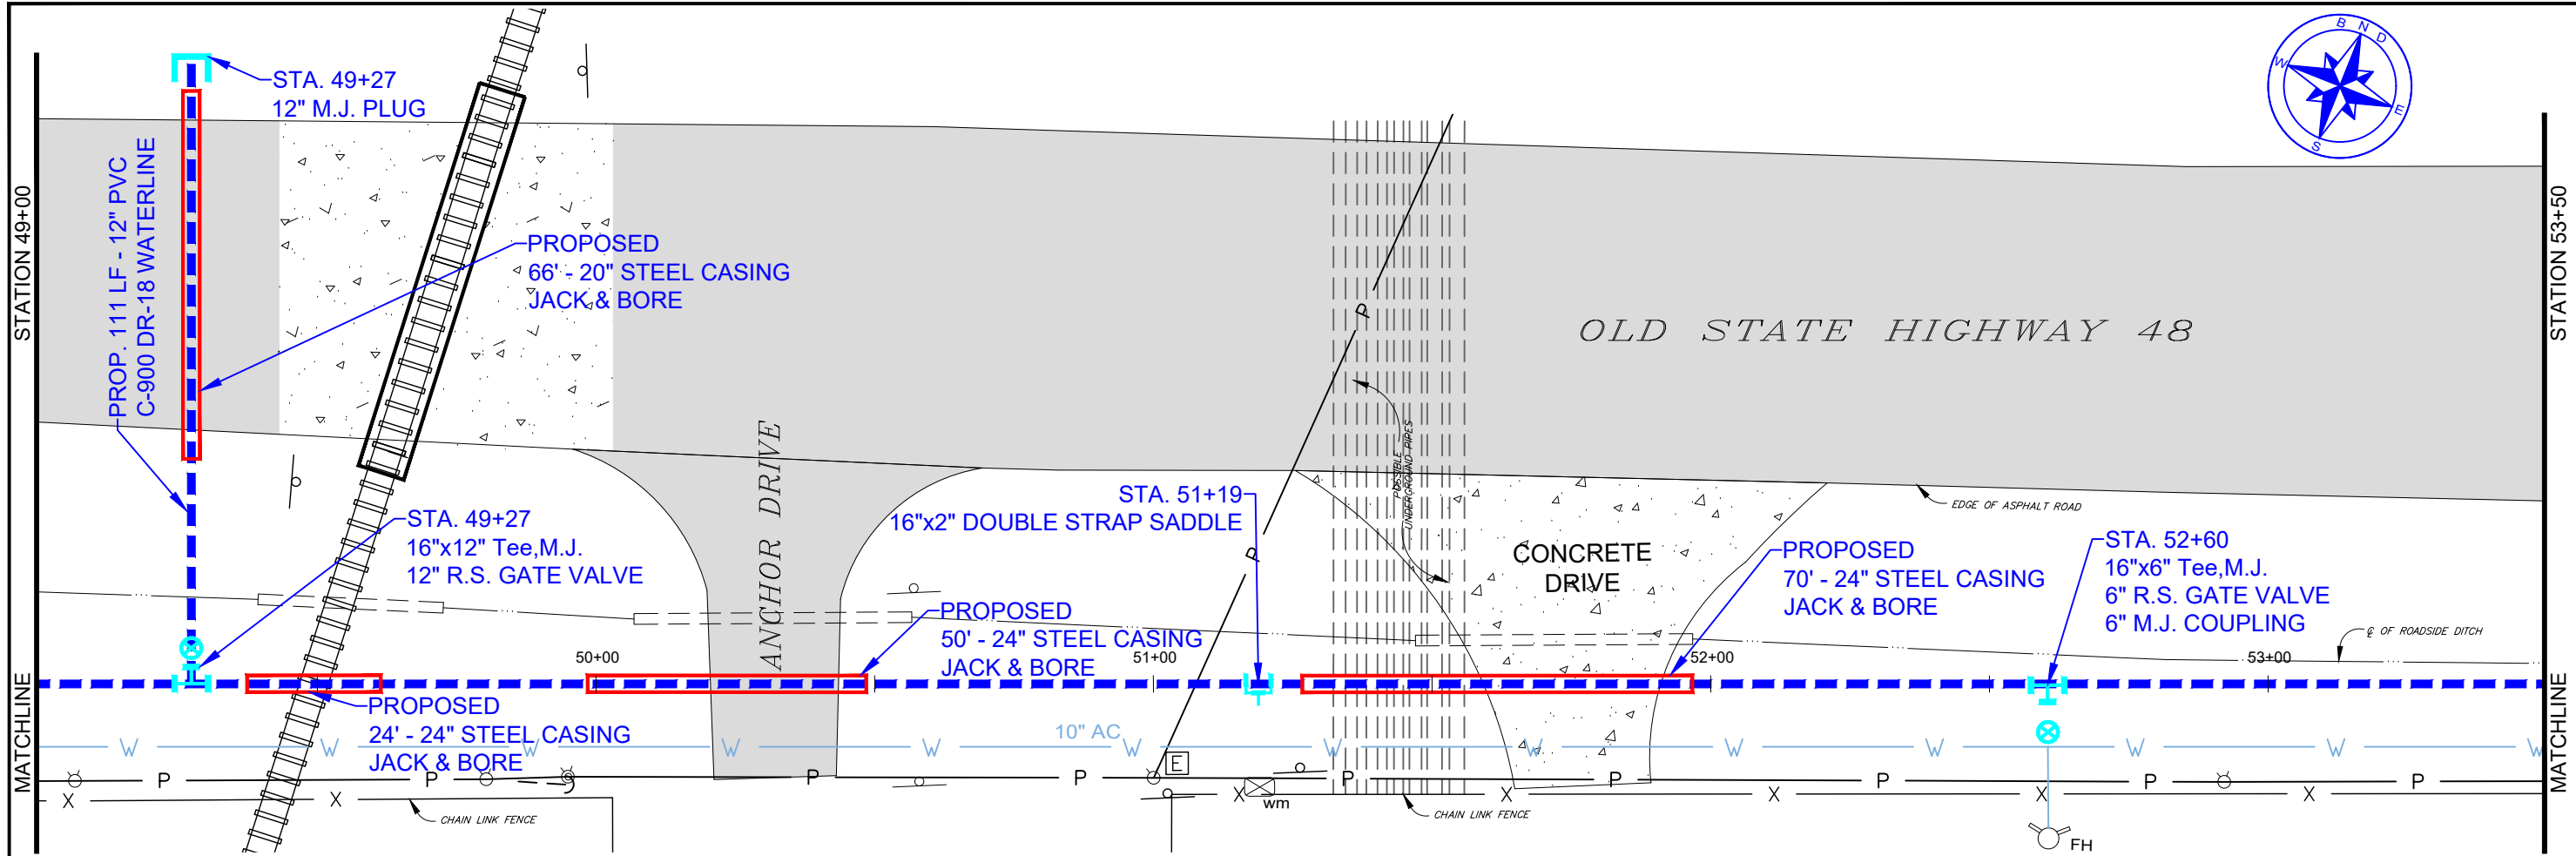


- NOTES:
1. BEFORE CONSTRUCTION CALL DIGTESS (1-800-344-8311), A NON-PROFIT UTILITY SPOTTING ORGANIZATION.
 2. VERIFY EXISTING WATER LINES PRIOR TO ORDERING FITTINGS.
 3. ALL FITTING SHALL BE MECHANICAL JOINT UNLESS SPECIFIED IN WRITING BY THE ENGINEER.
 4. LOCATION OF NEW FIRE HYDRANT WITH VALVE & BOX (6) TO BE DETERMINED ON FIELD.

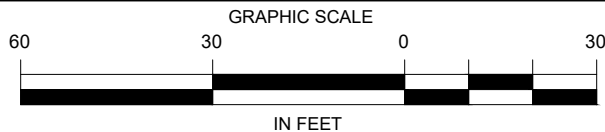

BROWNSVILLE NAVIGATION DISTRICT
ENGINEERING DEPARTMENT
BROWNSVILLE, TEXAS 78521
PHONE (956) 831-4592 1-800-378-5395
FAX (956) 831-6153
EMAIL achavez@portofbrownsville.com


DRAWN BY: P.E.	APPROVED BY:
DATE DRAWN: June 2020	REVISION DATE:
CHECKED BY: A. CHAVEZ II	DWG. NO.
SCALE: AS SHOWN	FILE NAME: C:\MY DRAWINGS\2020\water\2020WATERLINESREPLACEMENT\16in-OldSH48.dwg

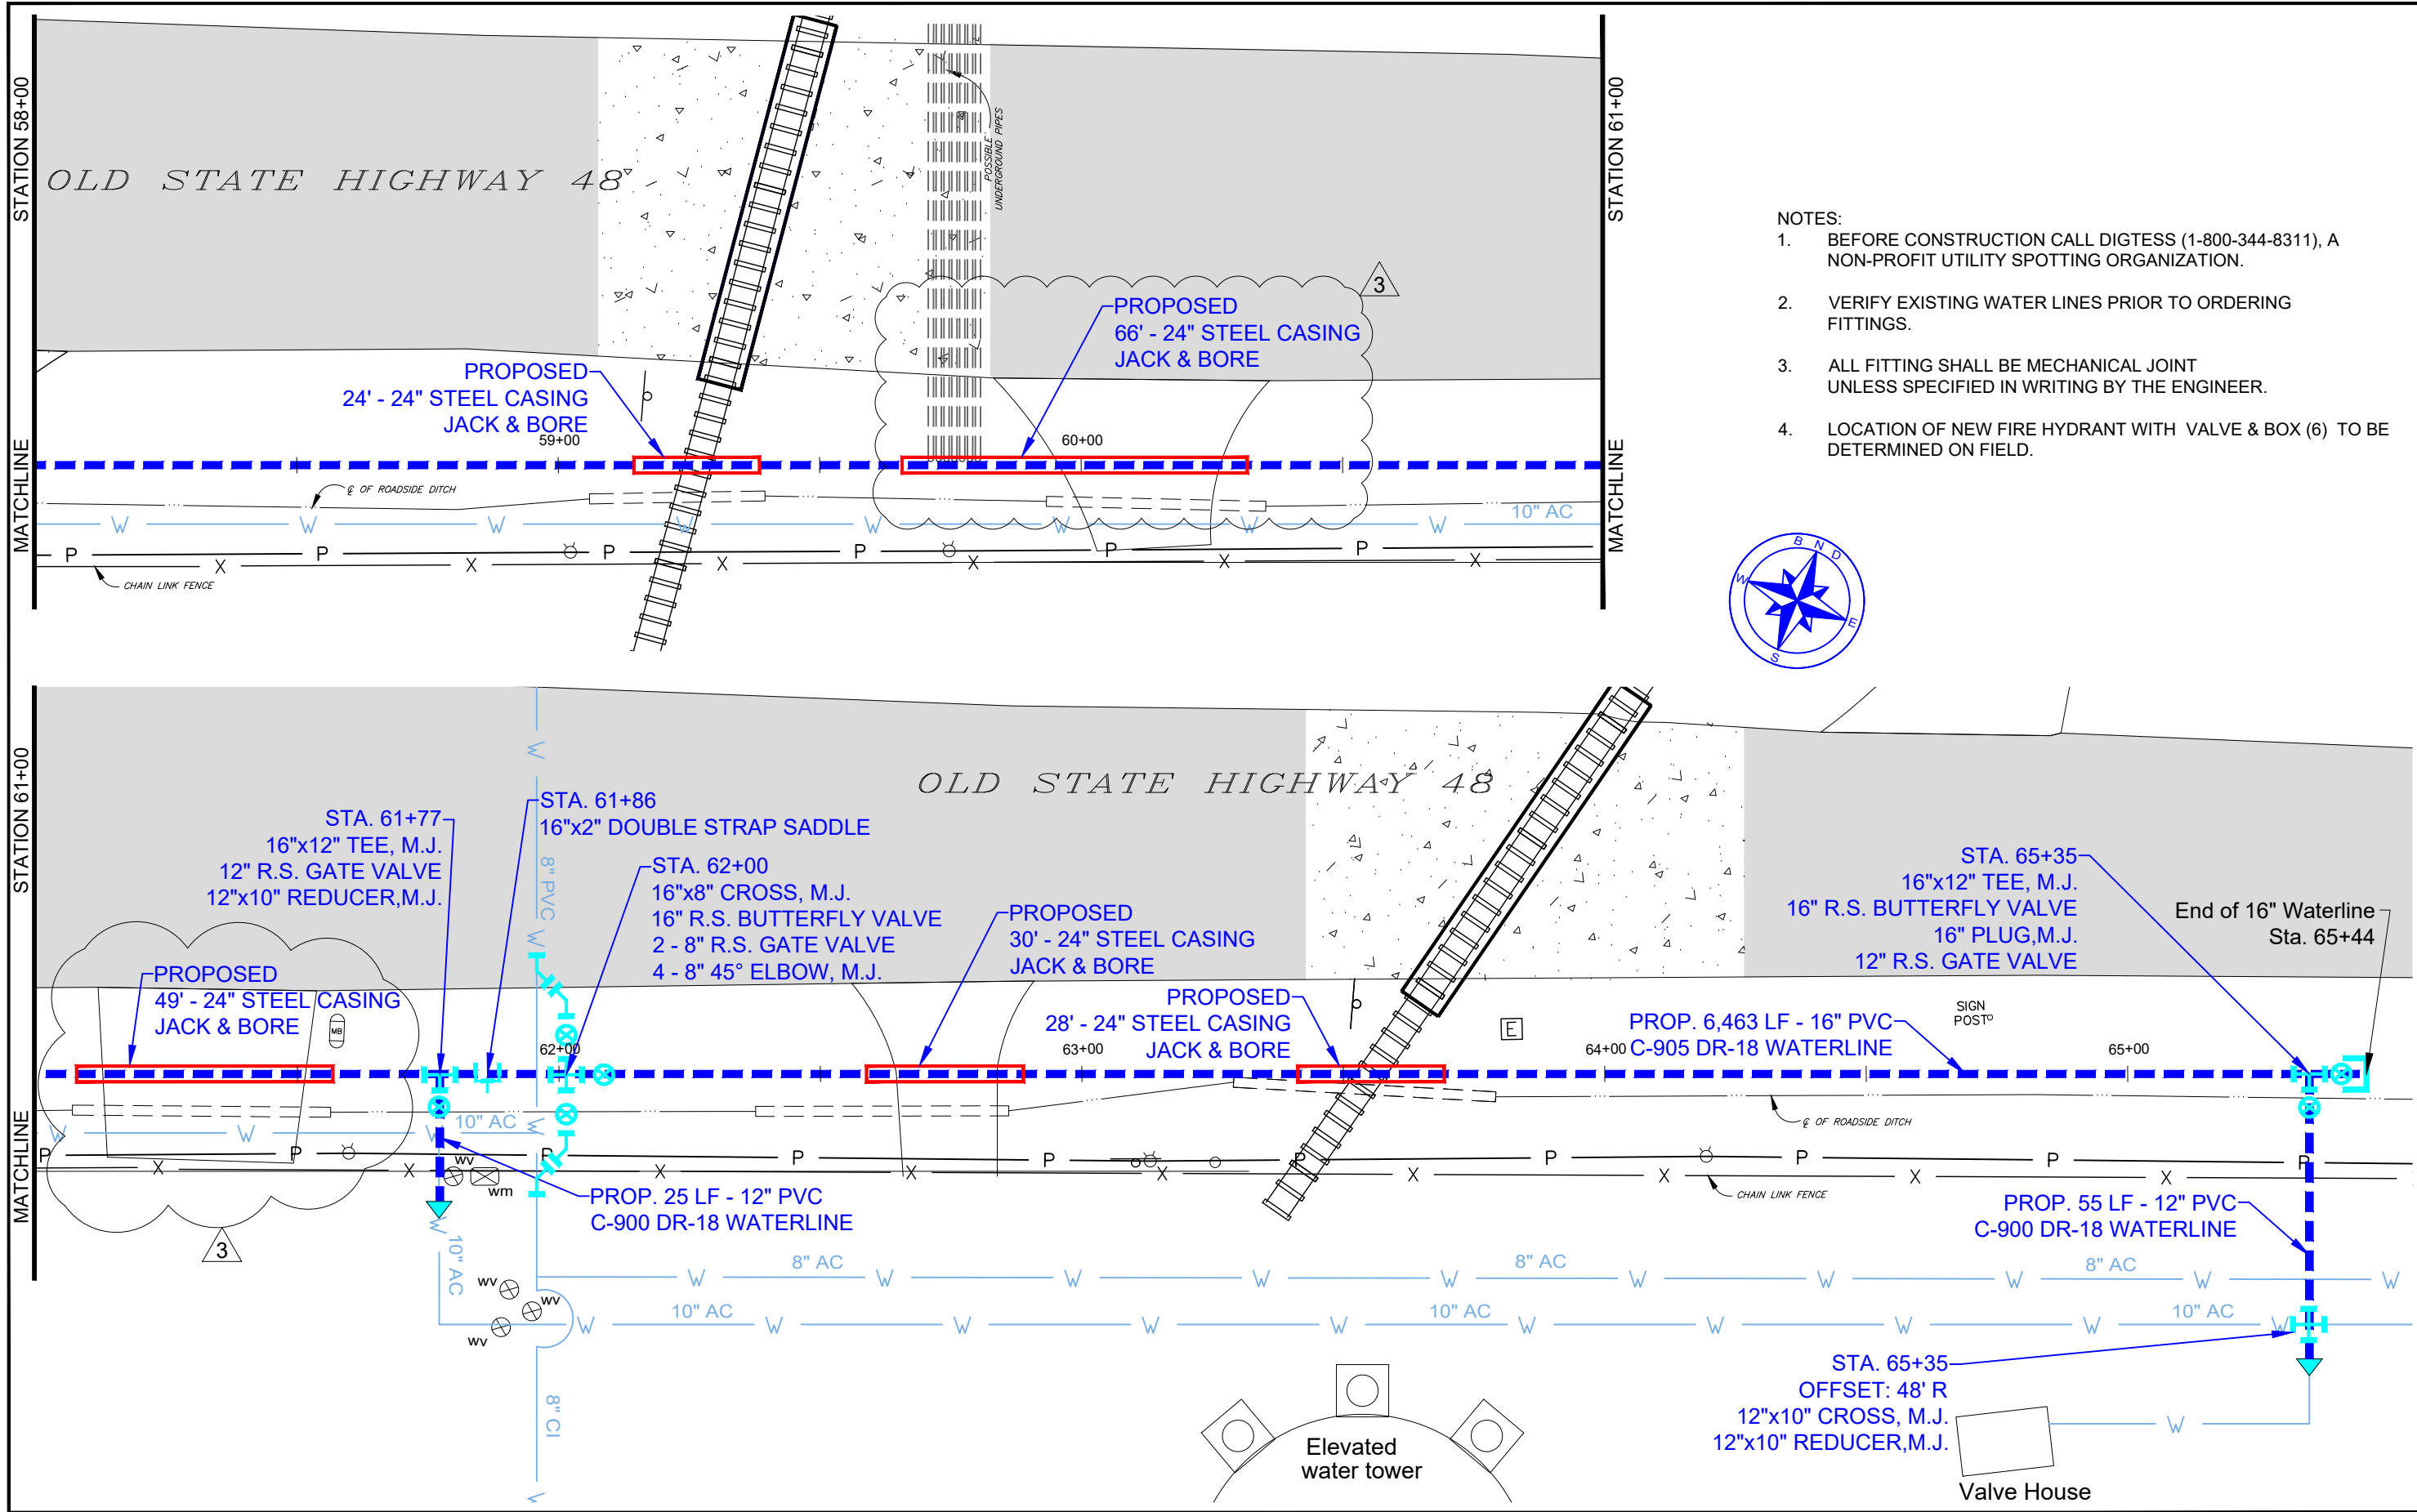

- NOTES:
- 1. BEFORE CONSTRUCTION CALL DIGTESS (1-800-344-8311), A NON-PROFIT UTILITY SPOTTING ORGANIZATION.
 - 2. VERIFY EXISTING WATER LINES PRIOR TO ORDERING FITTINGS.
 - 3. ALL FITTING SHALL BE MECHANICAL JOINT UNLESS SPECIFIED IN WRITING BY THE ENGINEER.
 - 4. LOCATION OF NEW FIRE HYDRANT WITH VALVE & BOX (6) TO BE DETERMINED ON FIELD.



REVISION	
3	ADDENDUM #3

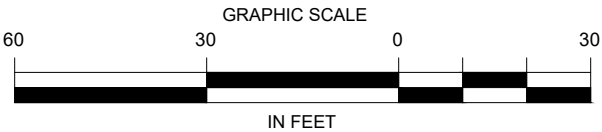

BROWNSVILLE NAVIGATION DISTRICT
ENGINEERING DEPARTMENT
BROWNSVILLE, TEXAS 78521
PHONE (956) 831-4592 1-800-378-5395
FAX (956) 831-6153
EMAIL achavez@portofbrownsville.com

the port that works


PROPOSED
16" WATERLINE
STA. 58+00 - 65+44

2020 BND WATER
LINES REPLACEMENT


DRAWN BY:	P.E.
DATE DRAWN:	June 2020
CHECKED BY:	A. CHAVEZ II
SCALE:	AS SHOWN

FILE NAME: C:\MY DRAWINGS\2020\water\2020WATERLINESREPLACEMENT\16in-045H46.dwg

SHEET
9
OF 14

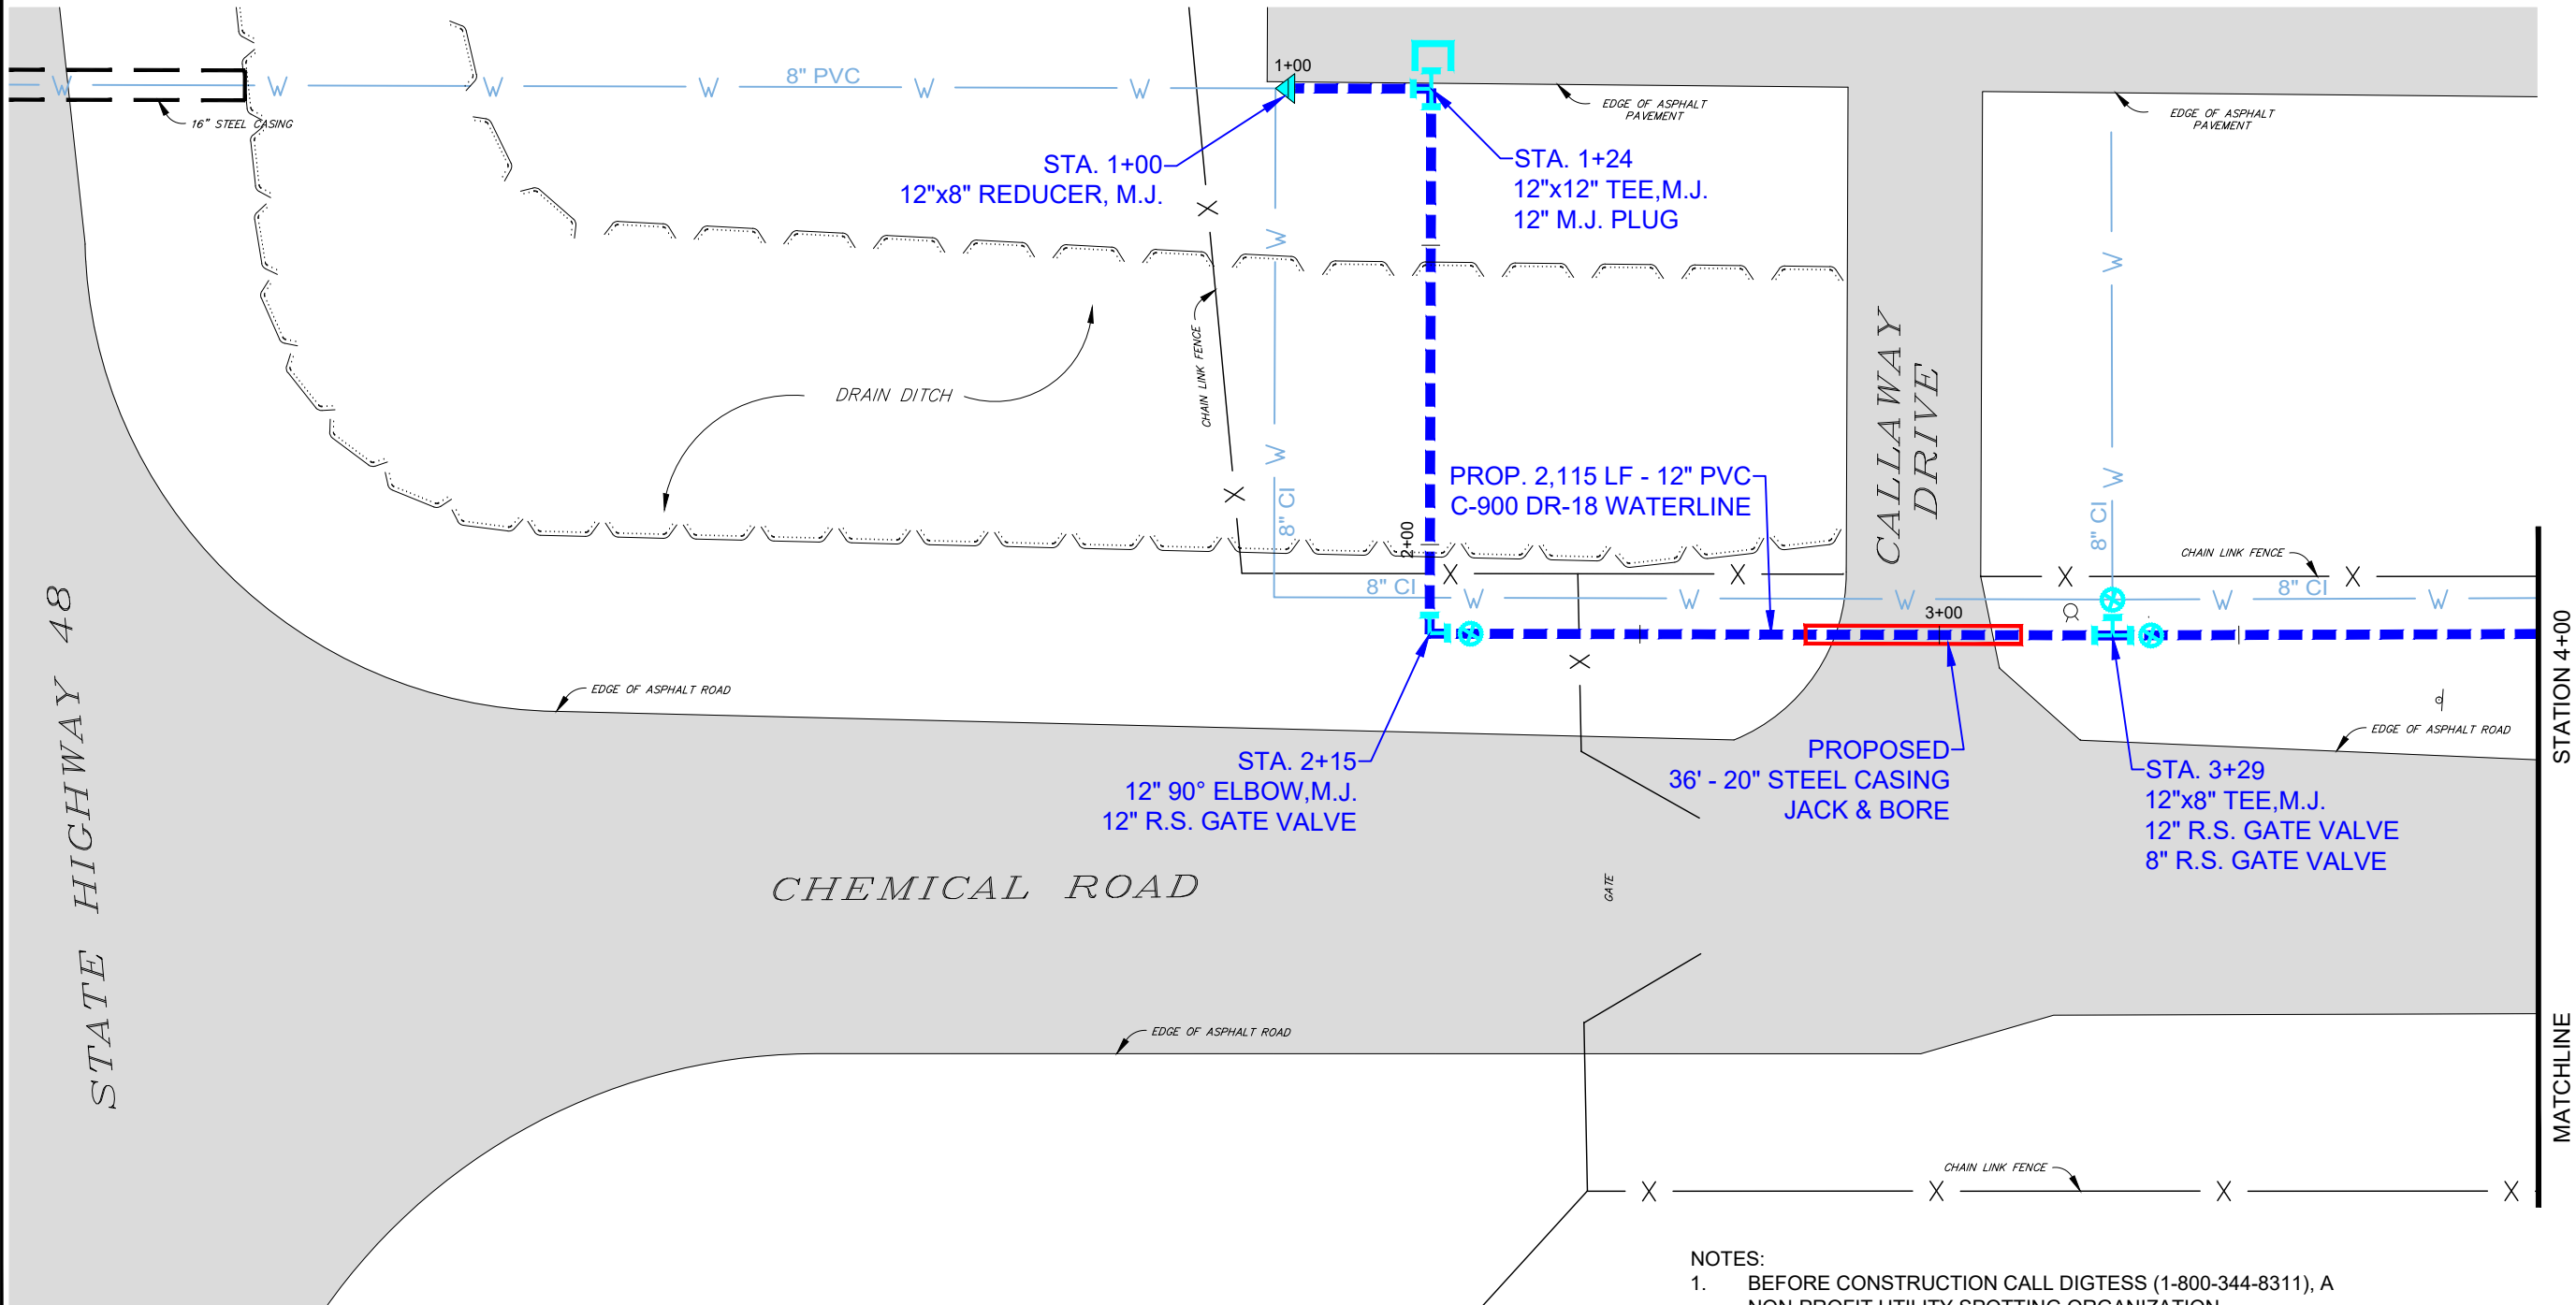


- NOTES:
1. BEFORE CONSTRUCTION CALL DIGTESS (1-800-344-8311), A NON-PROFIT UTILITY SPOTTING ORGANIZATION.
 2. VERIFY EXISTING WATER LINES PRIOR TO ORDERING FITTINGS.
 3. ALL FITTING SHALL BE MECHANICAL JOINT UNLESS SPECIFIED IN WRITING BY THE ENGINEER.

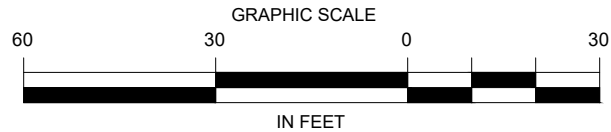



BROWNSVILLE NAVIGATION DISTRICT
ENGINEERING DEPARTMENT
BROWNSVILLE, TEXAS 78521
PHONE (956) 831-4592 1-800-378-5395
FAX (956) 831-6153
EMAIL achavez@portofbrownsville.com



DRAWN BY:	APPROVED BY:
P.E.	
DATE DRAWN:	REVISION DATE:
June 2020	
CHECKED BY:	DWG. NO.
A. CHAVEZ II	
SCALE:	FILE NAME:
AS SHOWN	C:\MY DRAWINGS\2020\water\2020WATERLINESREPLACEMENT\12in-Chemical.dwg

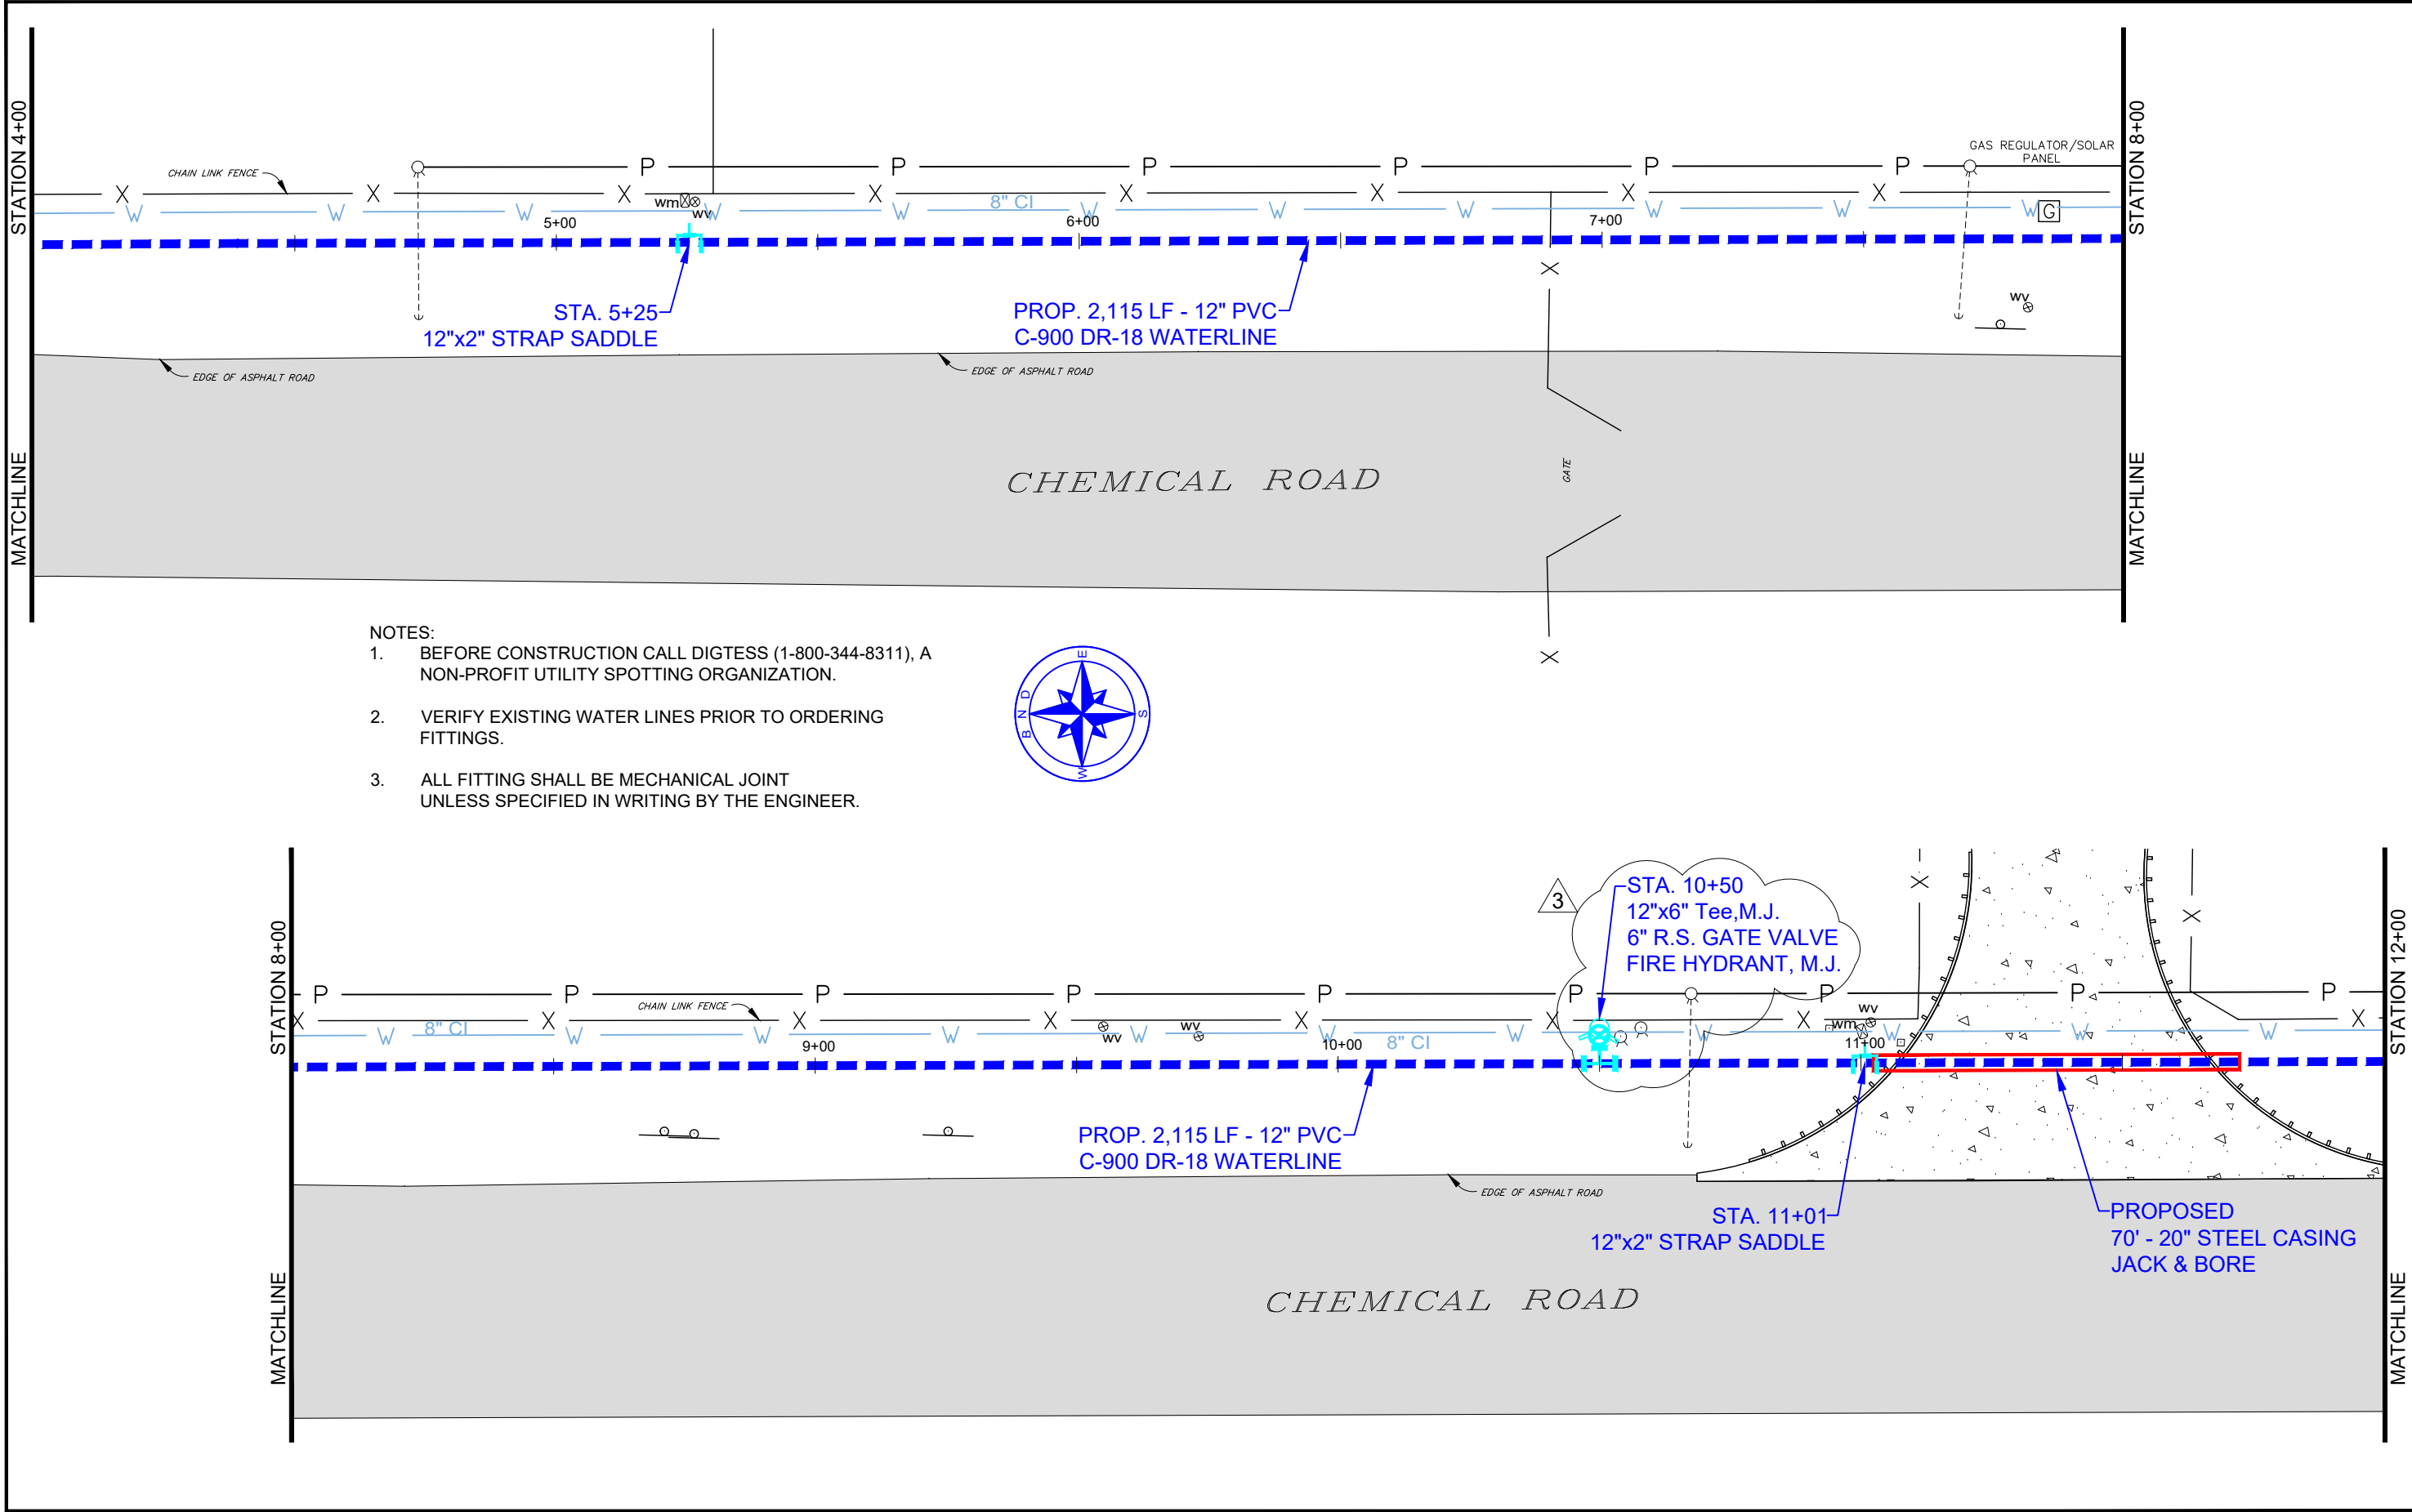


REVISION	
3	ADDENDUM #3

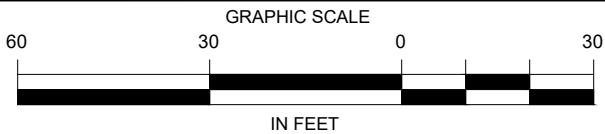

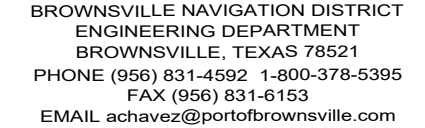

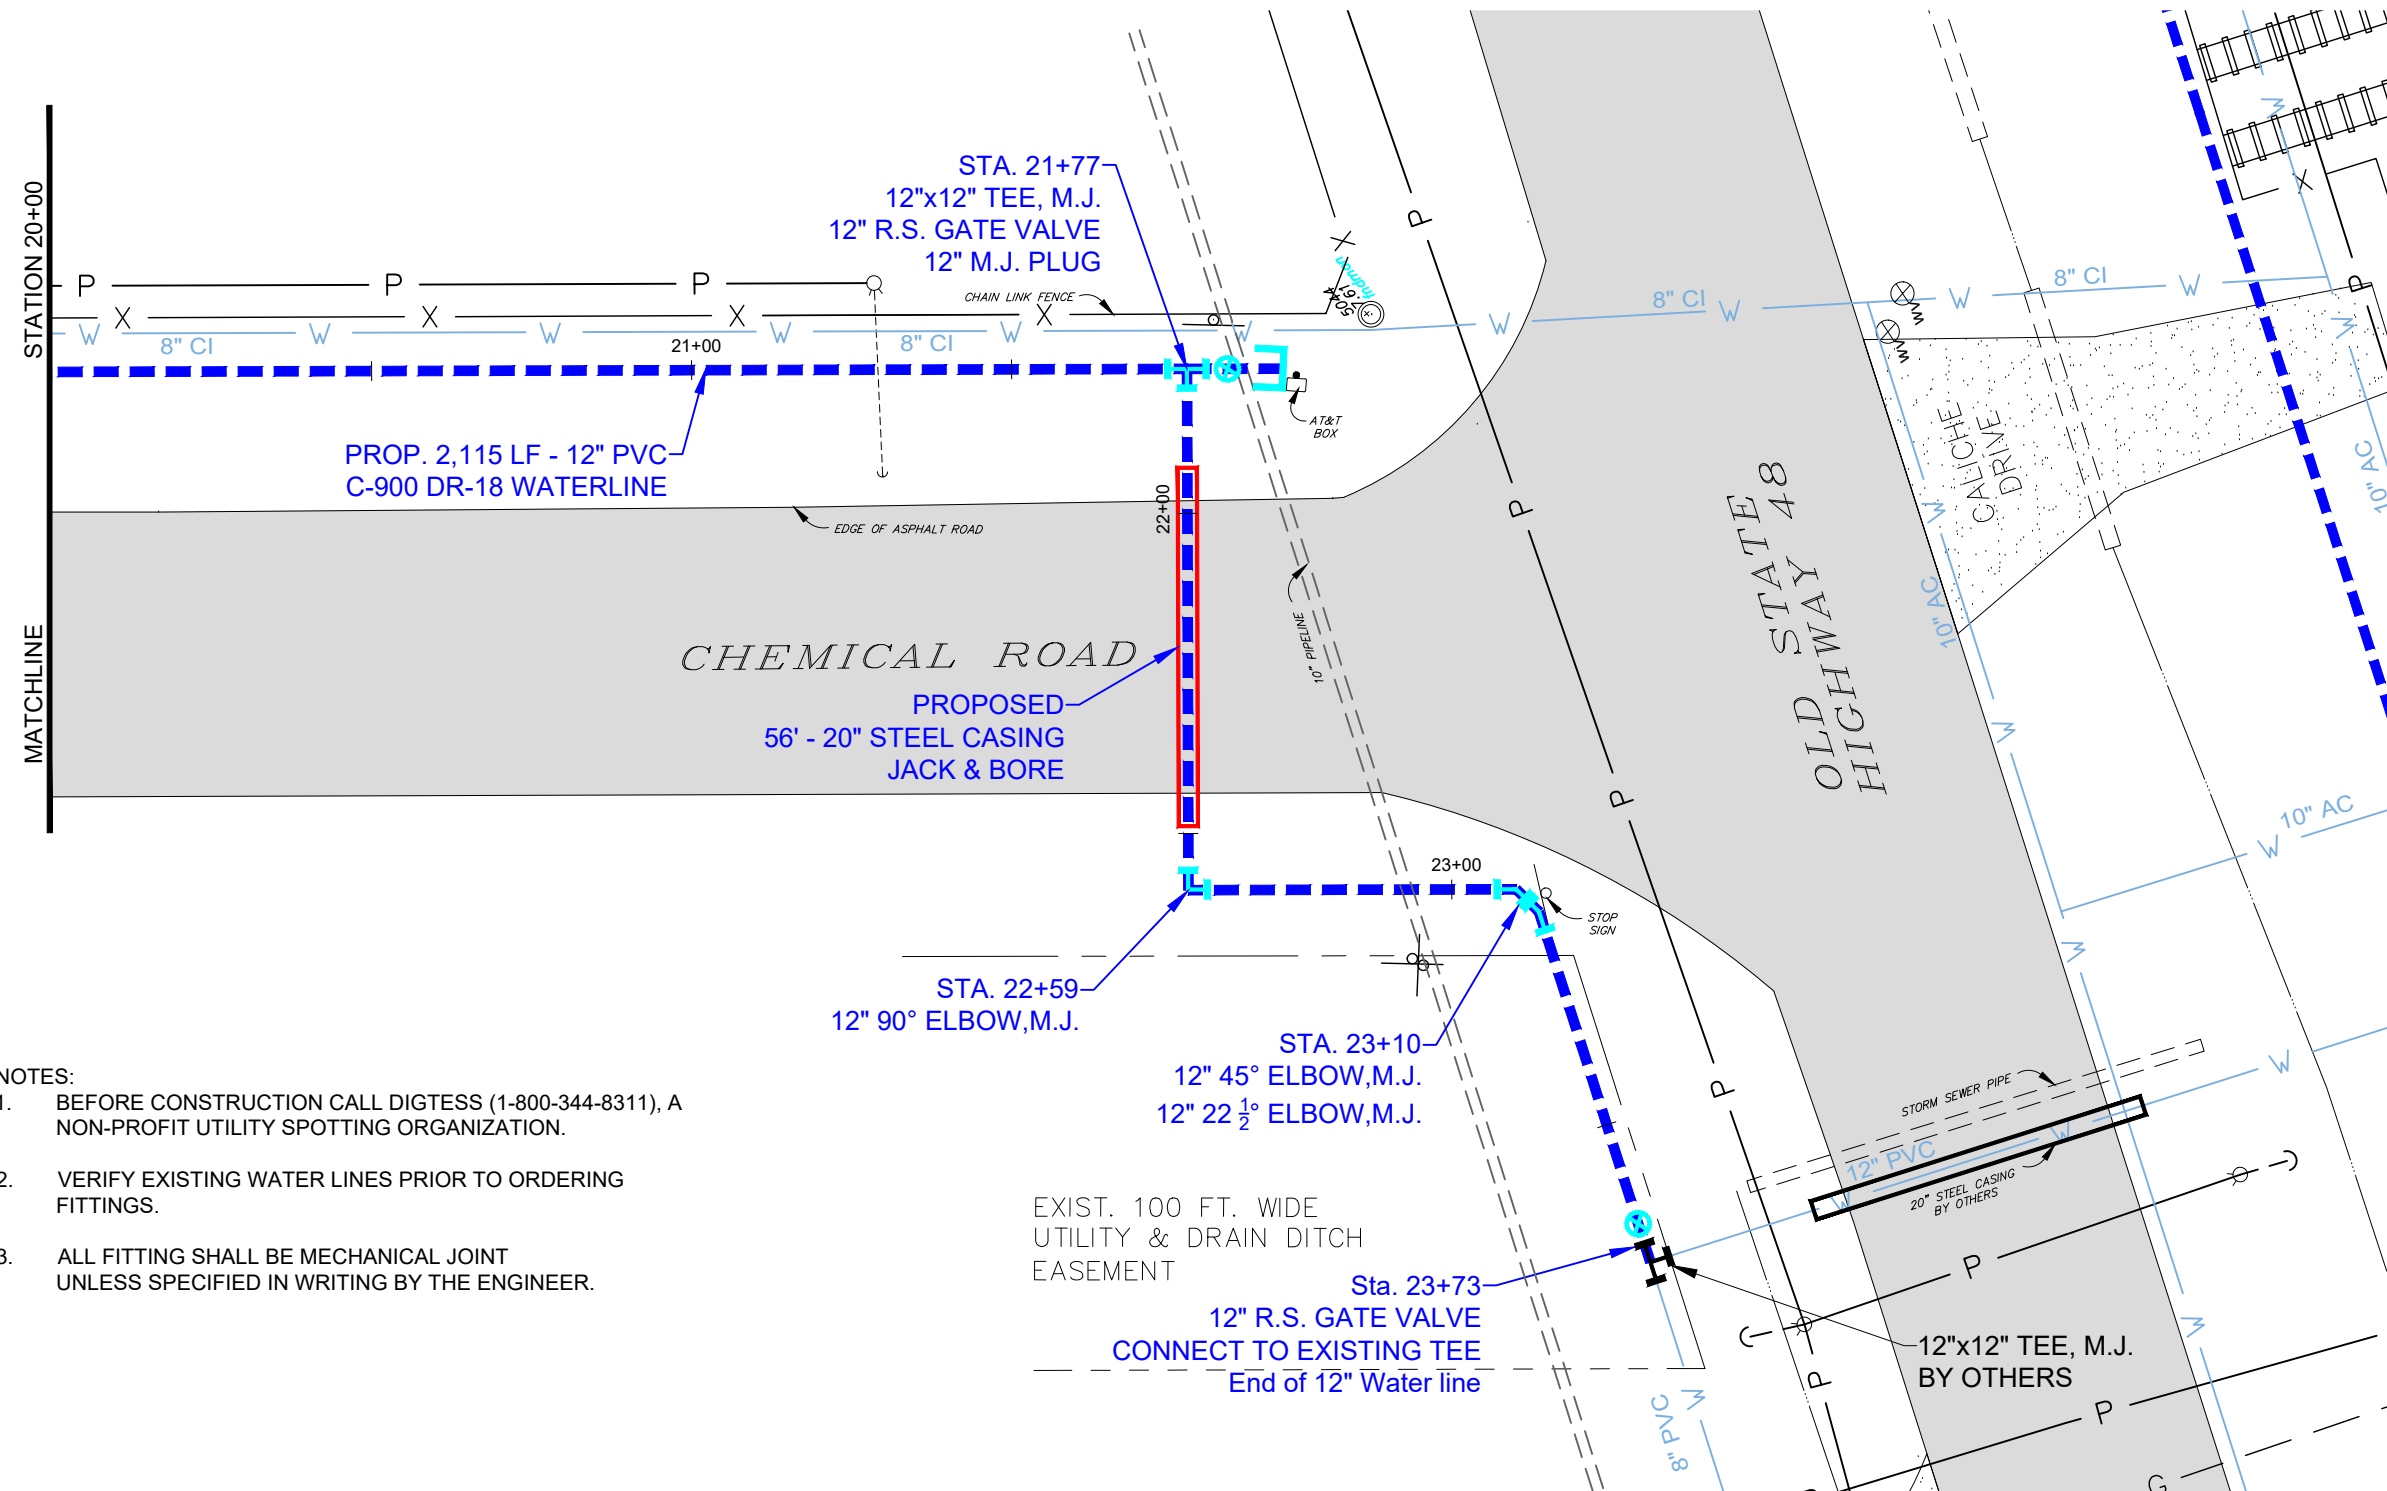

- NOTES:
1. BEFORE CONSTRUCTION CALL DIGTESS (1-800-344-8311), A NON-PROFIT UTILITY SPOTTING ORGANIZATION.
 2. VERIFY EXISTING WATER LINES PRIOR TO ORDERING FITTINGS.
 3. ALL FITTING SHALL BE MECHANICAL JOINT UNLESS SPECIFIED IN WRITING BY THE ENGINEER.

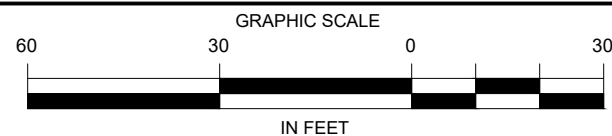

BROWNSVILLE NAVIGATION DISTRICT
ENGINEERING DEPARTMENT
BROWNSVILLE, TEXAS 78521
PHONE (956) 831-4592 1-800-378-5395
FAX (956) 831-6153
EMAIL achavez@portofbrownsville.com

DRAWN BY:	P.E.	APPROVED BY:	
DATE DRAWN:	June 2020	REVISION DATE:	
CHECKED BY:	A. CHAVEZ II	DWG. NO.	
SCALE:	AS SHOWN	FILE NAME:	C:\MY DRAWINGS\62water\2020WATERLINESREPLACEMENT12in-Chemical.dwg

